

## A Novel Concept of Facade for Daylighting and Natural Cooling

A. Neildez

Usinor/Sollac, Centre d'Essais de Gennevilliers  
27, avenue de la longue bertrane  
Villeneuve-la-Garenne, F93297-France  
neildez@cenerg.ensmp.fr

### ABSTRACT

The role of metallic surfaces is not only to save energy in winter and in summer by separating the inside and the outside. New and inexpensive ways of collecting solar energy for internal heating, new ways of ventilating, heating and cooling through the fabric elements are described. Two very significant prospects are : radiative cooling by metallic surfaces and enhancement of indirect daylighting by optimised ceilings. The subject of the European CURES program is to promote these new technologies by simulating and testing them.

### KEYWORDS

steel, daylighting, natural cooling, solar collector, radiative ceiling, facade component, reflector, experiment.

### INTRODUCTION

The companies who created the CURES consortium consider that there is a potential for improved daylight and natural cooling in office buildings with a number of new steel made components. The undertaken research on a novel concept of facade is part of a project entitled 'Components for Use in Renewable Energy Systems' (CURES) under a European Commission contract (JOR3-CT96-0102) managed by Dr Georges Deschamps. The project belongs to the JOULE research and development programme on non nuclear energy technologies [The European Commission (1996)].

The objective of the work is to produce a manufacture demonstrator of a serviced ceiling component and of a facade component appropriate for industrial production. They will have good aesthetic and durability qualities, and will be capable of production at minimum cost while giving significant improvement in energy consumption and user comfort. They will be for application on either new build, or for retrofitting on the existing building stock.

The members of the consortium and their specific objectives are :

- Sollac, steel manufacturer, to produce innovative steel components ;
- Sir Norman Foster, architect, to promote new aesthetic concept of facade ;
- Eyser, thermal consultant, to simulate and carry out experiment ;

- Energy Centre of Ecole des Mines for its knowledge on thermal computation;
- EDF, electric utility company, for its knowledge of innovative buildings for its own use and its customers.

## **STATE OF THE ART**

### ***Architectural Aspect of metallic construction***

Metallic surfaces in buildings can take many aspects and can perform many thermal functions at the same time. When correctly coated, such surfaces can insulate, heat, cool, light. The metallic building presents some obvious advantages (lightness, quickness of assembly, design freedom, savings) which are largely developed in industrial, commercial or farming buildings, and gains ground in public amenities (high schools, gymnasiums, station buildings, airports...). However from here it is a long step to having gained control over the domain of non residential buildings and private house sectors, except a few particular sectors like cyclones areas. Specific benefits in terms of daylight or thermal performance have to be found and have been found recently.

### ***Daylighting Aspect***

The evolution of modern architecture leads to give more place to natural lighting. The "international" glassed architecture is the reference everywhere, adapted or not to climate. As in car industry, where the designers impose larger and larger glazing surfaces as well, the engineers attempt in building construction to control the overheating effects by a control of solar penetration. In particular, all the new facade glazing allow for some spectral filtering, inferior to those developed for the car market.

On hot days with a high solar angle, users are turning on their lights to counteract the glare from the sunlit landscape outside the window, and the relative darkness of the office space. The solution we are investigating involves throwing daylight [Miller (March 1997), Miller (July 1997),] on to a reflective ceiling so that the space appears to be brighter. The Commerzbank Headquarters in Frankfurt is an example of natural daylighting. The architect has to avoid too violent contrasts, which is the reason for the frequent resort to natural indirect lighting reflected by the ceiling. We have to help him with optimised components. Porch roofs and sunscreens made of steel exist; their properties of reflection, diffuse or direct, remain to be optimised.

### ***Thermal Aspect***

From a comfort or energy savings point of view, the metallic construction is not well thought of; it still refers to volumes difficult to heat in winter and overheated in summer [Cousins et al]. Regarding heating, the metallic surfaces ("radiators") have quickly taken over at the end of 19<sup>th</sup> century from the hot air systems, except in the US. The metallic heating surfaces are placed in general along the vertical walls, to benefit from both radiation and convection.

With the traditional air-conditioning, the air is still the dominant vector [Barnard et al]. However, in Germany, the cooling ceiling has been developing for a decade ; it is an irrigated metallic surface, used as false ceiling and designed to ensure both convective and radiative transfer. In that case, the fluid is water which has better thermal exchange characteristics than air. This technology, noiseless and with low air speeds, is also currently developing in France. As an example, we can mention the rehabilitation of the head office of Nestlé company by Clestra. Its cooling power is limited except if one finds optimised radiative coatings or some other way to enhance heat extraction. If the ceiling is both chilled and daylight, it will remove the heat from the sunlit patch before it can warm up the room. As a sunlit patch will be much warmer than the ambient room temperature, the water in the chilled ceiling will be able to carry away greater quantities of heat than from the areas that are not sunlit. In other words, the room can be more brightly lit than a traditional sunshaded space, without discomfort to the user and while still using a water-based system for cooling.

## GLOBAL CONCEPT

The current research project is based on lessons learnt from a previous low energy building for EDF in Bordeaux, by the architects, Sir Norman Foster and Partners. That building achieved a 39% reduction in energy consumption compared to similar EDF buildings. Further possibilities appeared to be the basis for our work in this project. There are three basic options for the components as shown in figure 1.

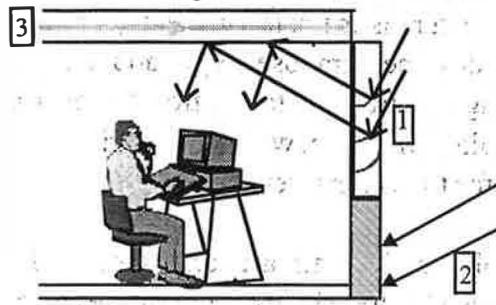


figure 1 : the three principles used

One is to reflect heat gain outside while still providing good levels of daylight inside ; the second one is to use solar irradiation to heat the space during winter ; the third one is to carry away excess heat in summer from occupied space through a ceiling component to provide comfort conditions without altering ambient temperatures.

### *Facade Component*

The facade component will reflect solar gain before it reaches the room (a classical-sized office), so that it will not actively heat the space. Thus, it will reduce peak loads for cooling so that a chilled ceiling will be adequate. The facade is divided into two zones ; an opaque highly insulated zone used as solar collector (2), a transparent zone with reflector panels to maximise daylight penetration at high level onto the ceiling (1). We developed geometries that would send sunlight, regardless of time of day or date during the cooling season, onto a controlled area of the ceiling. They may be ventilated with external air for better prevention of solar gains transfer to the inside, as shown on figure 2.




figure 2 : ventilated zone of facade (with reflectors)

### ***Ceiling Component***

The ceiling component (3) has two objectives. Firstly it allows cooling and heating to be water based rather than air based, cutting down on the energy needed to move heat around the building. Moreover, it is very important that the visible spectrum of daylighting is maximised, and that it is homogeneously distributed on the working surface. To achieve this, the ceiling will also act as a reflector delivering daylight as deep into the room as possible.

The output from the ceiling could be further increased by using the ceiling voids as an air supply plenum. Instead of a displacement ventilation system we suggest to throw fresh air under the ceiling. The maximum power of the ceiling is thus expected to be improved by increasing convection. The same principle leads us to design a "double face" ceiling with an active face towards the office and another one towards the ceiling. The latter would exchange heat or cold by convection with the fresh air blown into the false ceiling. While the technology for the chilled ceiling is relatively straight forward, we rely on an hypothetical sunscreen that can throw sunlight in a controlled way on to the ceiling.

## **STUDY OF PROPOSED CONCEPT**

### ***Heating and Cooling Plants***

In winter, hot water is produced by vertical solar collectors located on the south facade. Those collectors supply the ceiling for each office cell located on both northern and southern facade with water through a local storage. In summer, cold water is centrally produced by an absorption chiller which is supplied with hot water by horizontal solar collectors located on the roof. A central storage between solar collectors and absorption chiller is realised with a water tank with an electric extra back up.

### ***Simulations***

#### ***Heating and cooling needs***

The first simulation is a dynamic simulation of the thermal behaviour of the cell. Convection, conduction and radiation phenomena as well as inertia are modelled so as to assess heating and cooling needs of the office cell. The results are shown on figures 3 and 4.

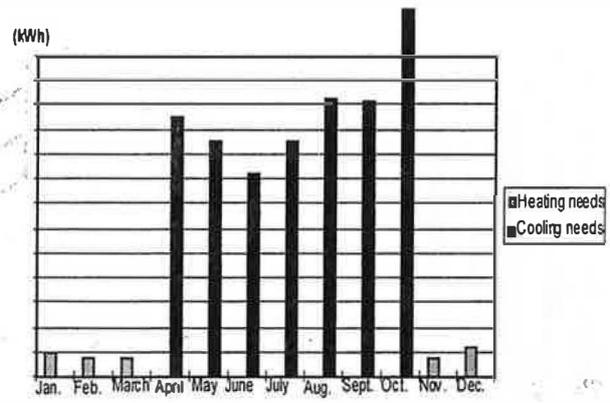
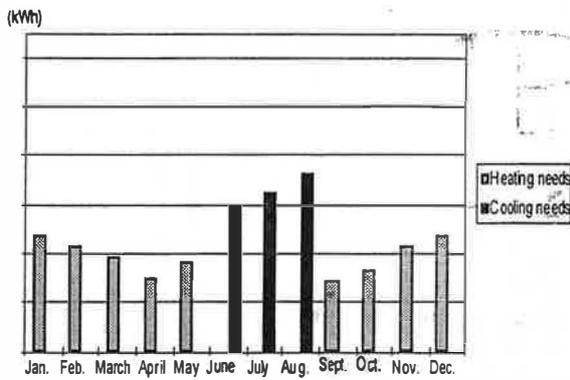


figure 3 : Lille, heating and cooling needs ; figure 4 : Madrid, heating and cooling needs  
*Collected solar energy*

The second simulation allows to assess the energy extracted from solar collectors located vertically on a south facade, in function of meteorological conditions, solar position and other characteristics (optical factor and loss coefficient). Different types of solar collectors were considered and their performances were compared on figures 5 and 6.

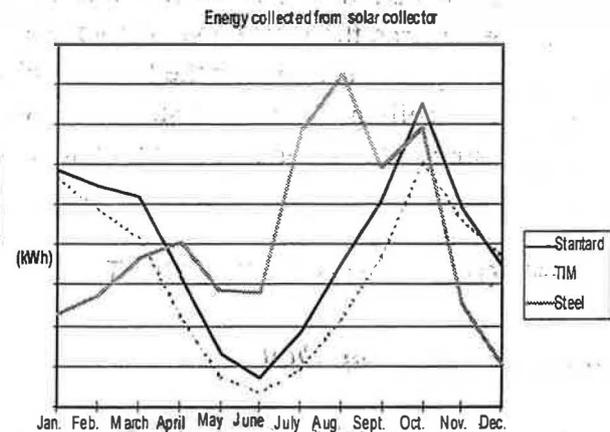
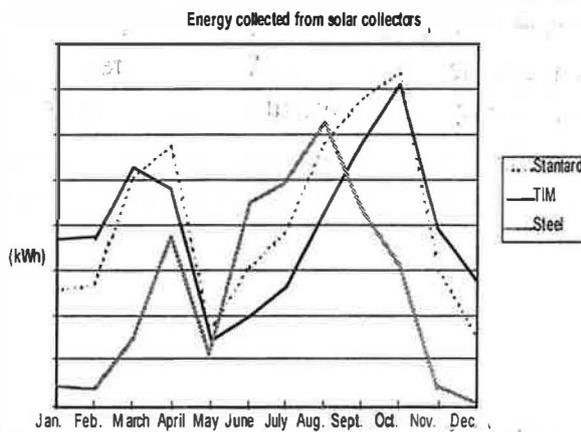


figure 5 : LILLE, orientation : south, water temperature : 30°C  
 figure 6 : MADRID, orientation : south, water temperature : 30°C

The reference is a standard solar collector with a glass panel in front of it and an air layer. We improved this solar collector by adding a Transparent Insulation Material (TIM) instead of the air layer. This collector has better performances in winter but is more expensive. A very cheap solar collector is a steel made one, with no glass protection. Its winter performances are very low. However, it could be financially interesting because of its very low investment cost (doubles up as the facade cladding).

Actually if we compare, refer to figures 7 and 8, the heating needs of an office cell and the energy recoverable in a steel solar collector, we notice that we provide a fraction of the heating energy required : from 16% in Lille to 50% in Madrid.

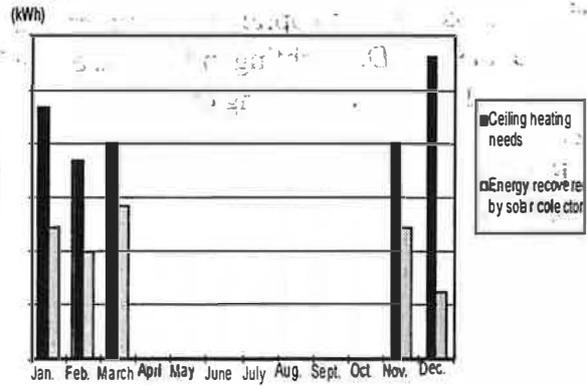
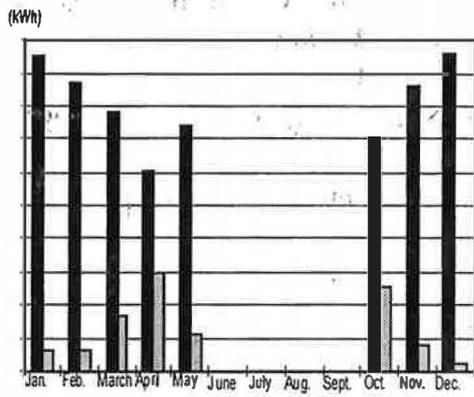


figure 7 : LILLE, Ceiling heating needs and energy extracted from steel solar collector  
 figure 8 : Madrid, Ceiling heating needs and energy extracted from steel solar collector

**Experiments**

Experiments are being performed on PASSYS test rig in Cadarache (in south of France). Firstly, the cell facade is fitted with a standard radiant ceiling, a standard collector with TIM and reflectors.

The first measurement campaign will allow to check the simulations and to design a steel made ceiling and solar collector. The latter will then be tested during a second campaign. The first results showed that the Klima facade was prone to drawing dust and airborne particles into the ventilated cavity, depositing them onto the reflectors, drastically reducing their efficiency.

**CONCLUSION**

The final results of testing and consequently the final products will be known in a few months. The study puts forward the new advantages for steel used in construction : to improve daylighting, less expensive and more comfortable heating and cooling, together with traditional advantages of low inertia.

The partners are going to enter the European THERMIE program for industrialisation of these components.

**References**

Barnard, N. and Ogden, R. The thermal capacity of steel framed buildings. from a paper presented at a seminar organised by British Steel.  
 Cousins, F. and Lang, B. Aspects of structural and thermal mass. from a paper presented at a seminar organised by British Steel.

- Hunn, B., Grasso, M., Rewerts, A. and Beaudry, M. (1996). Evaluation of directional shading fabric composites with application to improved daylighting. *HVAC&R Research* 2 : 4.
- Miller, B. (1997). Daylighting in Florida. *Solar Today* March/April 1997, 24-27.
- Miller, B. (1997). Daylighting on the cutting edge in Utah. *Solar Today* July/August 1997, 24-27.
- The European Commission DG XII (1996). Solar energy in architecture and urban planning. *Research Digest*.

