

The Total Design Approach for Commercial Kitchens

Kosonen R¹, Hagström K¹, Laine T²

1 Oy Halton Group Ltd, Vantaa, Finland

2 Olof Granlund Oy, Helsinki, Finland

Introduction

Kitchen design requires the expertise of many different specialists to produce designs that meet the requirements of productive and cost-effective working environments. The decisions of various designers strongly affect each other. Owners and end-users are important players in design process as well as cooking and ventilation equipment manufacturers. Due to the wide diversity of their expertise, a common understanding is needed to accelerate the process. An integrated design environment supports the entire design process e.g. visualization (Figure1). The total objective is to produce design data in a form that designers can utilize in different applications (1).

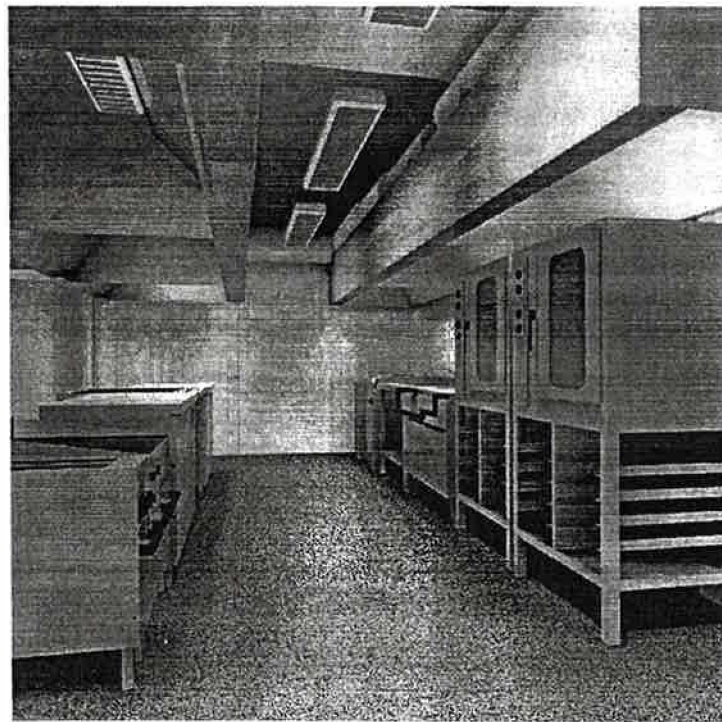


Figure 1. An example of the visualised kitchen workplace.

Design Methodology

The design of the professional kitchen environment follows the methodology of the industrial design process.(2) The kitchen layout design and time dependent internal loads are specified through the understanding of a specific restaurant and its food

service process, see Figure 2. Also the target levels for the IAQ and ventilation system performance are to be defined at an early stage of the design.

The local ventilation can be accomplished with modern kitchen hoods equipped with the most sophisticated features including capture air technology for maximum hood efficiency and local supply air with individual control for worker comfort.

Finally the Kitchen Air Conditioning Design can be performed taking into account the capture efficiency of individual hoods and loads from other internal and external sources. The total design approach allows designer to consider both IAQ and energy efficiency factors of chosen room air distribution system.

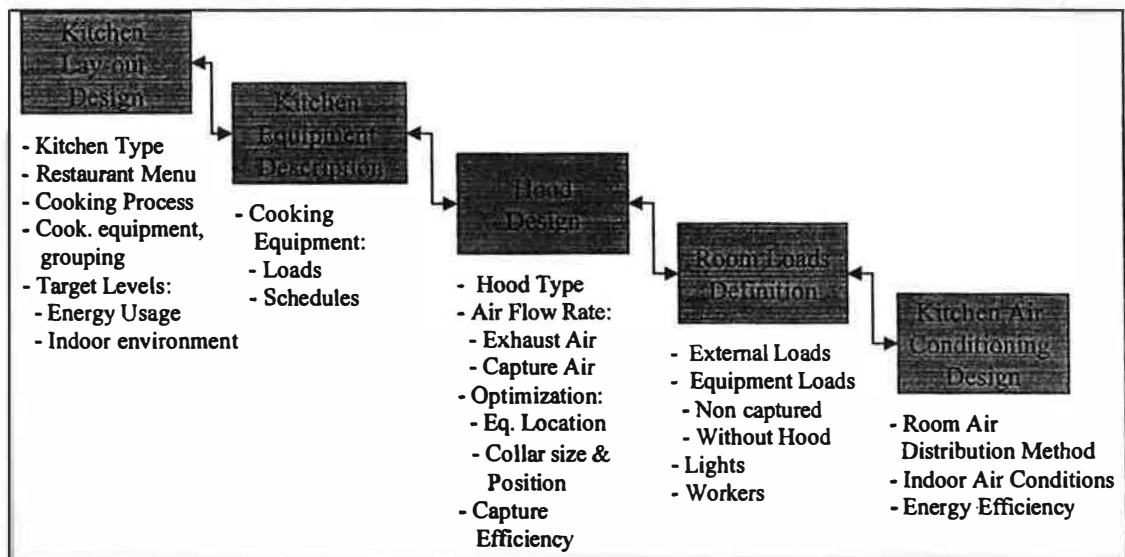


Figure 2. Professional Kitchen Design Process

Kitchen Layout Design

In the beginning of the kitchen design process the designer defines kitchen type and process type as an input. The layout design tool utilises the default data library and gives preliminary information regarding the type of menu, number of meals to produce in a day divided to different serving periods and size of portions. All default data library values are alterable if needed. In that way it is possible to specify preliminary values to get more detailed information.

The space dimensioning includes room estimates for all functional areas, such as receiving, storage, preparation, cooking, and dishwashing, that are required to produce the menu items. The space required for each functional area of the facility is dependent upon many factors. The factors involved include the number of meals to be prepared, the functions and tasks to be performed, the equipment requirements and the suitable space for traffic and movement.

Kitchen Hood Design

First the indoor air quality is selected by the designer together with the owner and the end-user. It means evaluation of indoor climate including target value adjustment for

temperature, humidity and air movement. After that the ventilation strategy of the kitchen space is pre-selected which is one of the key input value for kitchen canopies and hoods selection.

Based on kitchen equipment information (such as heat gain (sensible/latent), maximum electrical power and surface temperatures e.g.) the canopies are chosen. Selecting, dimensioning and placing of hoods and supply air devices could be performed by tools, such as energy analysis, CFD-simulation and manufactories tools.

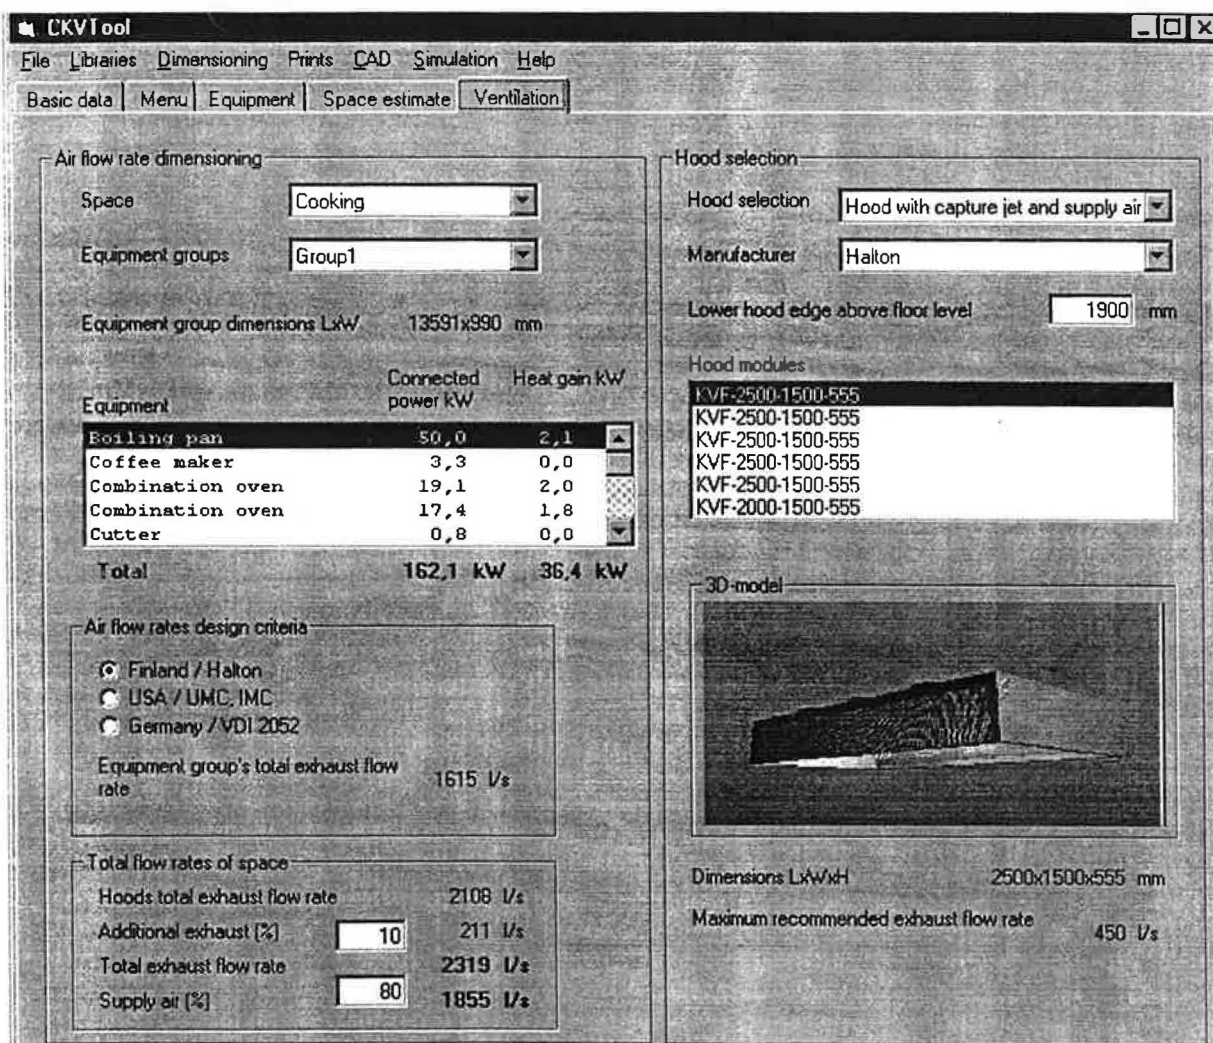


Figure 3. Hood selection in the kitchen ventilation design tool.

Kitchen Air Conditioning Design

Kitchen Air Conditioning system loads consists of the loads not captured with the individual hoods, and loads from other internal and external sources. The total system load is affected by the selection of the room air distribution method as the capture efficiency of the hoods is influenced by the selection.

The design of the kitchen environment is based on the pre-selected target levels for temperature, humidity and air movement. The total design approach allows designer to

evaluate both IAQ and energy efficiency of designed room air conditioning system towards set target levels.

Discussion

Currently used design tools for commercial kitchens are complicated to exchange data between different applications and key players. No integrated kitchen design environment is available although kitchen design requires the expertise of many different specialists and the decisions of various designers strongly affect each other.

The complex design, build, maintain and retrofit process has been mapped in order to provide a logical structure and flow for the kitchen design system. The developed prototype kitchen design tool demonstrates the capabilities and requirements of a truly integrated and efficient design process.

References

1. Laine T, Kosonen R., Gordon E., Kitchen design tool- An integrated environment for layout and ventilation design. Proceedings of Building Simulation '99, Kyoto Japan. September 13-15, 1999
2. Hagström Kim, Pöntinen Kalevi, Railio Jorma, Tähti Esko, Design Methodology of Industrial Air Technology. INVENT -report, TAKE, Helsinki April 1998.