

Ventilation for Enclosed Parking Garages

By **Moncef Krarti, Ph.D., P.E.**, and **Arselene Ayari, Ph.D.**
Member ASHRAE

Automobile parking garages can be partially open or fully enclosed. Partially open garages are typically above-grade with open sides and generally do not need mechanical ventilation. However, fully enclosed parking garages are usually underground and require mechanical ventilation. Indeed, in the absence of ventilation, enclosed parking facilities present several indoor air quality problems. The most serious is the emission of high levels of carbon monoxide (CO) by cars within the parking garages. Other concerns related to enclosed garages are the presence of oil and gasoline fumes, and other contaminants such as oxides of nitrogen (NO_x) and smoke haze from diesel engines.

To determine the adequate ventilation rate for garages, two factors are typically considered: the number of cars in operation and the emission quantities. The number of cars in operation depends on the type of the facility served by the parking garage and may vary from 3% (in shopping areas) up to 20% (in sports stadiums) of the total vehicle capacity. The emission of carbon monoxide depends on individual cars including factors such as the age of the car, the engine power, and the level of car maintenance.

For enclosed parking facilities, ANSI/ASHRAE Standard 62-1989, *Ventilation for Acceptable Indoor Air Quality* specifies a fixed ventilation rate of below 7.62 L/s·m² (1.5 cfm/ft²) of gross floor area.² Therefore, a ventilation flow of about 11.25 air changes per hour is required for garages with 2.5 m (8 ft) ceiling height.

However, some of the model code authorities specify an air change rate of four to six air changes per hour. In addition, some of the model code authorities allow the ventilation rate to vary and be reduced to save fan energy if CO-demand controlled ventilation is performed, that

is, a continuous monitoring of CO concentrations is conducted, with the monitoring system being interlocked with the mechanical exhaust equipment. The acceptable level of contaminant concentrations varies significantly from code to code. A consensus on acceptable contaminant levels for enclosed parking garages is needed.

Unfortunately, Standard 62-1989 does not address the issue of ventilation control through contaminant monitoring for enclosed garages. Thus, ASHRAE commissioned a research project (945-RP) to evaluate current ventilation standards and recommend rates appropriate to current vehicle emissions/usage.

Ventilation Regulation

Table 1 provides a summary of existing codes and standards for ventilating enclosed parking garages in the United States, and other selected countries. As shown in Table 1, the recommendations for the CO exposure limits are not consistent between various regulations within the United States and other countries. However, the recommendations offer an

indication of risks from exposure to CO in parking garages. A limit of 25 ppm for long-term CO exposure would meet almost every code and standards listed in Table 1.

The ventilation rate requirements recommended by ASHRAE and other codes are independent of the characteristics of the parking garage and do not consider the various parameters that may affect indoor air quality, such as the emission generation rate and the acceptable pollutant level. A new design method is needed to determine the ventilation rate required for a wide range of enclosed parking garages. This design method should be flexible to accommodate not only the various CO exposure limits defined by the standards but also the changing emission inventory from motor vehicles.

Field Testing Results

As part of an ASHRAE-sponsored project (945-RP), field measurements for the seven tested parking facilities were performed. The air change rates are measured using the tracer gas technique. First, the tracer gas (SF₆) was injected in the building directly or through the supply fans. Then, the concentration of the tracer gas was monitored using a field-portable electron capture gas chromatograph. For a more detailed description of the field measurements, see Reference 4.

About the Authors

Moncef Krarti, Ph.D., P.E., is an associate professor in the Civil, Environmental and Architectural Engineering (CEAE) Department at the University of Colorado at Boulder. He is a member of TC 6.9, Thermal Storage, and and TC 4.7, Energy Calculation. **Arselene Ayari, Ph.D.**, is a consultant engineer in indoor air quality and control systems.

R-OMNI



THE BEST IDEAS ARE SIMPLE. LOOK AROUND!

R-OMNI is the first new thing to happen to round diffusers in decades. Designed for architectural ceilings and facades with exposed ductwork, the R-OMNI presents a clean (and completely smooth) profile for any building style.

The R-OMNI is configured for use with or without ceilings, and is adjustable for **horizontal** or **vertical projection**. That means it's ideal in VAV applications, and equally as effective for heating and cooling.

A few well-rounded points:

- Flow over 1000 cfm—quietly.
- Full 360 degree air pattern offers excellent air distribution performance.
- Removeable face for easy installation, damper adjustment and cleaning.
- Optional low-smudge outer cone.

Put a fresh new face on your air distribution design—the R-OMNI.
Find your local Titus representative at www.titus-hvac.com.

 **Titus**
The Leader in Air Management
(Circle No. 20 on Reader Service Card)

Table 2 summarizes some of the results obtained during the field testing for seven garages described in Ayari, et al. (2000). The ACH values present the range of the air changes per hour measured at various locations of the facility using the tracer gas technique, while the L/s·m² (cfm/ft²) values provide the total ventilation rate.

The maximum and the average CO concentrations measured during the day of testing are listed in Table 2 to characterize the indoor quality within the tested parking facility. As indicated in Table 2, the CO level within all the parking garages never exceeded 35 ppm even though the ventilation rates in all cases is well below the 7.62 L/s·m² (1.5 cfm/ft²) recommended by Standard 62-1989. The only garage that has a ventilation rate close to 7.62 L/s·m² (1.5 cfm/ft²) is Garage E, which serves a large shopping mall with heavy usage throughout the day. It should be noted that all the garages are ventilated continuously except Garage B, where CO sensors were used to control the opera-

tion of the supply fans.

From the field study, the following results were obtained:

1. All the tested enclosed parking garages had contaminant levels that are significantly lower than those required by even the most stringent regulations (i.e., 25 ppm of 8-hour weighted average of CO concentration).

2. The actual ventilation rates supplied to the tested garages were generally well below those recommended by Standard 62-1989 (i.e., below 7.62 L/s·m² [1.5 cfm/ft²]).

3. When it is used, demand controlled ventilation was able to maintain acceptable indoor air quality within the tested enclosed parking facilities.

4. The location of supply and exhaust vents, traffic flow pattern, the number of moving cars, and travel time were important factors that affect the effectiveness of the ventilation system in maintaining acceptable CO (or NO_x) levels within enclosed parking garages. Any design guidelines should account for these factors to determine the ventilation requirements for enclosed parking facilities.

It is clear from the results of the field study that the current ventilation rate specified in Standard 62-1989 is outdated for enclosed parking garages. New design guidelines are needed to provide the minimum ventilation rate required to maintain contaminant concentrations within parking facilities at the acceptable levels set by the relevant health authorities without large penalties in fan energy use. Guidelines should account for variability in the parking garage traffic flow, car emissions, travel time, and number of moving cars.

Design Approach

Based on the results of several para-


	Time (hrs)	PPM	Ventilation
ASHRAE	8 1	9 35	7.6 L/s · m ² (1.5 cfm/ft ²)
ICBO	8 1	50 200	7.6 L/s · m ² (1.5 cfm/ft ²)
NIOSH/ OSHA	8 Ceiling	35 200	—
BOCA	—	—	6 ACH
SBCCI	—	—	6-7 ACH
NFPA	—	—	6 ACH
ACGIH	8	25	—
Canada	8 1	11/13 25/30	—
Finland	8 15 minutes	30 75	2.7 L/s · m ² (0.53 cfm/ft ²)
France	Ceiling 20 minutes	200 100	165 L/s · car (350 cfm/car)
Germany	—	—	3.3 L/s · m ² (0.66 cfm/ft ²)
Japan/South Korea	—	—	6.35-7.62 L/s · m ² (1.25-1.5 cfm/ft ²)
Netherlands	0.5	200	—
Sweden	—	—	0.91 L/s · m ² (0.18 cfm/ft ²)
U.K.	8 15 minutes	50 300	6-10 ACH

Table 1: Summary of U.S. and international standards for ventilation requirements of enclosed parking garages.

metric analyses,⁴ a simple design method was developed to determine the ventilation flow rate required to maintain acceptable CO level within enclosed parking facilities. Ventilation rates for enclosed parking garages can be expressed in terms of either flow rate per unit floor area (L/s·m² or cfm/ft²) or air volume changes per unit time (ACH). The design ventilation rate required for an enclosed parking facility depends on four factors:

1. Contaminant level acceptable within the parking facility;
2. Number of cars in operation during peak conditions;
3. Length of travel and operation time

Get the Specs You Need.

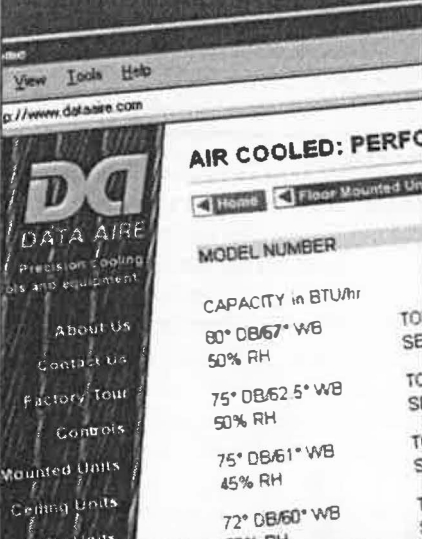

DATA AIRE
Precision Cooling
Units and Equipment

Home | Floor Mounted Units

AIR COOLED: PERF

MODEL NUMBER

CAPACITY in BTU/hr

60° DB/67° WB
50% RH

75° DB/62.5° WB
50% RH

75° DB/61° WB
45% RH

72° DB/60° WB
50% RH

TO SE
TO SE
TO S
T


DATA AIRE INC.
Online specifications
and diagrams for all
Data Aire products.

www.DataAire.com
1-800-347-2473

(Circle No. 53 on Reader Service Card)



PETRA

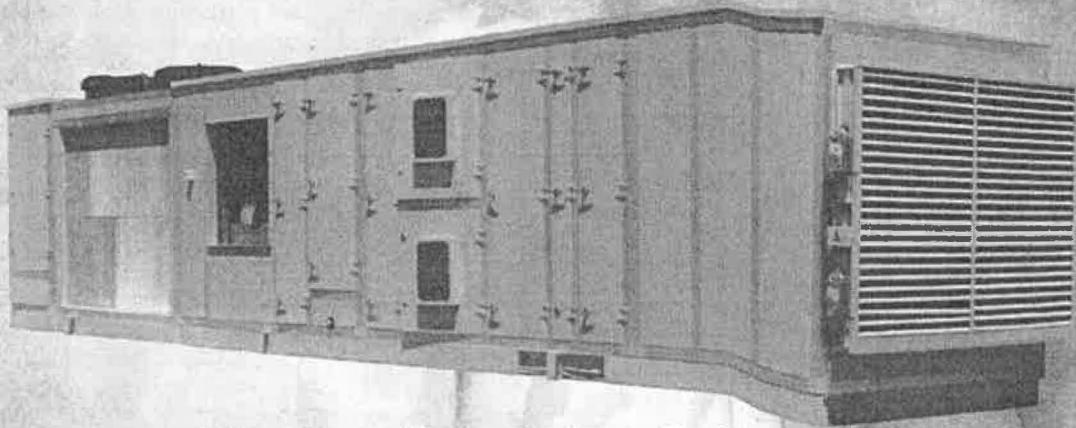

a step ahead of the rest

The Chimes Shopping Center located in Uxbridge, UK is a leisure center with a gross floor area of 100,000m². The main contractor is the world renowned Costain -Skanska JV and the overseeing consultants are Ove Arup & Partners. The required noise levels at the site boundary were particularly stringent and could not be achieved with commercially available products in the industry. Taking into consideration the strict low noise requirements of this and other UK projects, Petra developed their new range of super silent chillers and packaged rooftop air conditioning units.

Petra manufactures a wide range of products using world famous suppliers of materials, components and equipment. Petra's products range from mini split units to large Water Chillers, Air Handlers, Packaged Air Conditioning Units, and more. Petra provides a wide range of high quality standard products, as well as offering highly engineered custom made products. Petra's superior product quality, competitive prices and short delivery times, have enabled it to meet specific market demands and serve constantly growing overseas markets easily. Petra has gained the trust and confidence of many corporations worldwide, which have adopted its units as standard in their commercial and Industrial projects.

Petra is in the process of setting up its marketing and distribution activities in the USA.



Petra Engineering Industries Co.

PO Box 141351
Amman 11814 - JORDAN
Tel (9626) 5531508 Fax 5531513

E-mail: petrasho@go.com.jo
Website: www.petra-eng.com



EUR



- Abu Dhabi - U.A.E. Tel (9712) 6391308 Fax 6211027
- Ramallah - West Bank Tel/Fax (9702) 2960701
- Tunis - Tunisia Tel (2161) 706681/2/3 Fax 706684
- Jeddah - S.A. Tel (9662) 6930000 Fax 6283923
- Karachi - Pakistan Tel (9221) 4534161 Fax 4538162
- Petersham - Australia Tel (612) 95180255 Fax 9518027
- Beyrut - Lebanon Tel (9611) 663573 Fax 646209
- Cairo - Egypt Tel/Fax (202) 2754463/72
- Burray - UK Tel 44 (1737) 226088 Fax 244461
- Doha - Qatar Tel (974) 4691546 Fax 4687258

of cars in the parking garage; and,

4. Emission rate of a typical car under various conditions.

Data for these factors should be available to determine accurately the design ventilation rate for enclosed parking garages. A simple design approach is presented in the following section to determine the required ventilation rate for existing and newly constructed enclosed parking garages.

General Procedure for the Design Method

To determine the required design flow rate to ventilate an enclosed parking garage, the following procedure can be followed:

Step 1. Collect the following data:

1. Number of cars operating during the hour of peak use, N (# of cars). The ITE Trip Generation Handbook⁵ is a good source to estimate the value of N .

2. Average CO emission rate for a typical car per hr, ER, (gr/hr). The CO emission rate for a car depends on several factors such as vehicle characteristics, fuel types, vehicle operation conditions, and environment conditions.⁴ Data provided in the ASHRAE Handbook¹ and reproduced in Table 3 can be used to estimate CO emission rates for a typical car. Typically, hot starts are common in facilities where cars are parked for short periods such as shopping malls. Meanwhile, cold starts characterize facilities where cars park during long periods such as office buildings.

3. Average length of operation and travel time for a typical car, T (seconds). The ASHRAE Handbook gives average entrance/exit times for vehicles. Higher values may be used for worst case scenarios such as during rush hours or special events.

4. The level of CO concentration acceptable within the garage, CO_{max} (ppm).

5. Total floor area of the parking area, A_f (m^2).

Step 2.

1. Determine the peak generation rate, GR ($gr/hr \cdot m^2$ [$gr/hr \cdot ft^2$]), for the parking garage per unit floor area using Equation 1:

$$f' = \frac{GR}{GR_0} \times 100 \quad (1)$$

2. Normalize the value of generation rate using a reference value $GR_0 = 26.8 \text{ gr/hr} \cdot m^2$ ($GR_0 = 2.48 \text{ gr/hr} \cdot ft^2$). This reference value was obtained using the worst emission conditions (cold emissions in winter season) for an actual enclosed parking facility:⁴

$$GR = \frac{N \times ER}{A_f} \quad (2)$$

Step 3. Determine the required ventilation rate per unit floor area ($L/s \cdot m^2$ or cfm/ft^2) the correlation presented by Equation 3 depending on the maximum level of acceptable CO concentration CO_{max} :

$$L/s \cdot m^2 = C f' T \quad (3)$$

Where, the correlation coefficient, C is given below:

$$1.204 \times 10^{-3} L/m^2 \cdot s^2 \text{ (} 2.370 \times 10^{-4} \text{ cfm/ft}^2 \cdot \text{s) for } CO_{max} = 15 \text{ ppm}$$

$$C = 0.692 \times 10^{-3} L/m^2 \cdot s^2 \text{ (} 1.363 \times 10^{-4} \text{ cfm/ft}^2 \cdot \text{s) for } CO_{max} = 25 \text{ ppm}$$

$$0.482 \times 10^{-3} L/m^2 \cdot s^2 \text{ (} 0.948 \times 10^{-4} \text{ cfm/ft}^2 \cdot \text{s) for } CO_{max} = 35 \text{ ppm}$$

and T is the average travel time of cars within the garage in seconds.

Example

Consider a two-level enclosed parking garage with a total capacity of 450 cars, a total floor area of 89,300 ft^2 (8300 m^2), and an average height of 9 ft (2.75 m). The total length of time for a typical car operation is two minutes (120 s). Determine the required ventilation rate for the enclosed parking garage in $L/s \cdot m^2$ and in ACH so that the CO levels never exceeds 25 ppm. Assume that the number of cars in operation is 40% of the total vehicle capacity (a shopping mall facility).

Step 1. Garage data: $N = 450 \times 0.4 = 180$ cars, $ER = 11.66 \text{ gr/min}$ (average emission rate for a winter day using the data from Table 3), $T = 120 \text{ s}$, $CO_{max} = 25 \text{ ppm}$.

Step 2. Calculate CO generation rate:

$$(a) \quad GR = \frac{180 \times 11.66 \text{ gr/min} \times 60 \text{ min/h}}{8300 \text{ m}^2} = 15.17 \text{ gr/h} \cdot \text{m}^2$$

$$(b) \quad f' = \frac{15.17}{26.8} \times 100 = 56.6$$

Step 3. Determine the ventilation requirement:

Using the correlation of Equation 3 for $CO_{max} = 25 \text{ ppm}$, the design ventilation rate in $L/s \cdot m^2$ can be calculated:

$$L/s \cdot m^2 = 0.692 \times 10^{-3} \times 56.6 \times 120 \text{ s} = 4.7$$

Or in terms of air change per hour:

$$ACH = \frac{4.7 L/m^2 \cdot s \times 10^{-3} L/m^3 \times 3600 \text{ s/h}}{2.75 \text{ m}} = 6.1$$

NEW... Automated Commercial HVAC Design

Drawing: Right-CommDraw
Drag & drop smart HVAC shapes for fast design. Read/Write AutoCADtm DWG and DXF files for easy interface.

Loads: Right-CommLoad
ASHRAE 24 hour method, Handbook of Fundamentals.

Ducts: Right-CommDuct
ASHRAE Duct Fitting Data-Base with Static Regain, Equal Friction.

Proposal: Right-CommProposal
Maximize profitability by generating fast and accurate job costs.



wrightsoft™

Also from Wrightsoft: **Right-Suite Residential**
Load calculations, Duct sizing and layout, Equipment selection, Radiant panel design, Geothermal loop design and job quotes in minutes!

1-800-225-8697 www.wrightsoft.com
30-Day Money Back Guarantee on all software Unlimited Technical Support.

(Circle No. 54 on Reader Service Card)

Garage	Location	Capacity (# cars)	ACH [Tracer]	L/s · m ² [Tracer]	cfm/ft ² [Tracer]	Maximum CO (ppm)	Average CO (ppm)
Garage A	Denver	1,700	2.2-4.2	1.78	0.35	16	7
Garage B	Denver	250	5.0-7.0	4.57	0.90	20	4
Garage C	West Plains, N.Y.	1,000	0.0-2.6	1.11	0.22	40	15
Garage D	West Plains, N.Y.	138	3.6-4.5	3.00	0.59	19	12
Garage E	West Plains, N.Y.	258	5.8-8.8	5.68	1.12	25	14
Garage F	Rochester, Minn.	448	7.77	5.28	1.04	10	9
Garage G	Mahtomedi, Minn.	81 (trucks)	0.90-1.02	2.43	0.48	12	1

Table 2: Summary of field testing results for seven U.S. parking garages.

Notes

- If emission rate was based on ER = 6.6 gr/min (which corresponds to 80% hot emissions and 20% cold emissions based on data provided in Table 3), the required minimum ventilation rate will be 3.5 ACH (i.e., 2.67 L/s·m²).
- The assumed travel time is higher than any value provided by ASHRAE¹ and is used to represent a worst case scenario (Christmas evening or an unusual event). If a longer travel time of 3 minutes is used, the design ventilation rate will be 7.05 L/s·m² or 9.2 ACH (close to the current ventilation rate recommended by Standard 62-1989).

Summary and Conclusions

In this article, a new design method is presented to determine the minimum ventilation rate for enclosed parking garages. The new design procedure is flexible and can account for several factors including the maximum acceptable CO level, the number of moving cars, the average vehicular CO emission rate, and the average travel time within the parking garage.

A field testing study in various U.S. locations has showed that the actual ventilation rates used in enclosed parking garages are significantly lower than the rates recommended by Standard 62-1989 (i.e., 7.62 L/s·m² 1.5 cfm/ft²). A more detailed description of the results for this field study is provided in the article in Reference 3. With the continual decrease in average vehicular contaminant emission rate, it is expected that the ventilation rate requirements for enclosed parking garages will be reduced. Therefore, the initial cost for the mechanical ventilation system can be reduced. Moreover, the use of contaminant-based ventilation controls will achieve significant savings in operating cost of the ventilation system in parking garages.¹

However, further research is needed to determine the maximum acceptable contaminant levels within parking garages due to both car emissions, gasoline fumes, and oil vapors. In addition, more field testing and simulation analysis are required to evaluate the effects of poor mixing conditions (due for instance to poor system design) in determining the minimum required ventilation rates.

Acknowledgments

This article is part of the work performed for the ASHRAE

Season	Hot Emissions (Stabilized), grams/min		Cold Emissions, grams/min	
	1991	1996	1991	1996
Summer (32°C [90°F])	2.54	1.89	4.27	3.66
Winter (0°C [32°F])	3.61	3.38	20.74	18.96

Table 3: Typical CO emissions within parking garages.¹

Project 945-RP. The authors thank ASHRAE for its support.

References

1. 1999 ASHRAE Handbook for HVAC Applications, Chapter 12.
2. ANSI ASHRAE Standard 62-1989, Ventilation for Acceptable Indoor Air Quality.
3. Ayari, A., R.A. Grot, M. Krarti, 2000. "Field evaluation of ventilation system performance in enclosed parking garages," ASHRAE Transactions, 106(1).
4. Krarti, M., A. Ayari, and R.A. Grot, 1999. "Evaluation of fixed and variable rate ventilation system requirements for enclosed parking facilities." Final report for ASHRAE Project 945-RP.
5. ITE, 1998. Trip Generation Handbook, Institute of Transportation Engineers, Washington, D.C. ●

Vibration & Noise Control Products

since 1983

for Industrial, HVAC, and Acoustic Applications

• Spring Isolators



• Anti-Vibration Pads



• Elastomer Isolators



• Expansion Joints



• Floating Floors, Air Mounts, Inertia Bases.....

• Ancillary Product Lines

Piping Supports

Adjustable Swivel Hangers
Clevis Hangers
Roller Hangers
Roller Chairs
Pipe Clamps

Ducting Accessories

Damper quadrants
Stuck-up pins
Splitter dampers
Ball Joints
Access Door Locks

Instrumentation

Thermometers
Pressure Gauges
Misc:
Test plugs Automatic airvents
Syphons Gauge cocks



VIMCO

VIBRATION MANAGEMENT CORPORATION

3532-A East TC Jester
Houston - Texas 77018, USA

Browse our online catalog at www.vimco.org

T: +1 (713) 263 - 8181

F: +1 (713) 263 - 1133

E: vibmcorp@worldnet.att.net

(Circle No. 48 on Reader Service Card)

ASHRAE Journal

57