

# THE HVAC COSTS OF INCREASED FRESH AIR VENTILATION RATES IN OFFICE BUILDINGS

J.H. Eto, P.E.      C. Meyer  
ASHRAE Member

## ABSTRACT

This study reports on the changes in annual energy operating costs and in equipment sizing that result from increased minimum outside air ventilation rates. The analysis is based on parametric DOE-2.1C simulations for a large office building in 10 different U.S. and three Canadian locations. In the simulations, minimum ventilation rates are increased from 2.5 liters per second per person (L/s.person) or 5 cubic feet per minute per person (cfm/person) to 10.0 L/s.person or 20 cfm/person. Annual building energy costs are calculated using current electricity and natural gas tariffs for each location. The results suggest that, for the building and climates examined, higher minimum outside air ventilation rates will affect equipment-sizing decisions relatively more than they will affect annual building energy use. Increases in annual energy operating costs were small (less than 5%), because electricity is the dominant component of cost and electricity is used primarily for non-space-conditioning purposes. Estimates of the increase in HVAC first cost suggest that higher ventilation rates will have small effects (less than 0.5%) on total building construction costs.

## INTRODUCTION

ASHRAE Standard Project Committee 62-1981R is in the process of revising Standard 62-1981, "Ventilation for Acceptable Air Quality." The revisions will have far-reaching consequences for building owners and operators since the standards is likely to be incorporated into building codes at some point in the future [McNall 1984]. Currently, there are two methods of compliance: a prescriptive method, which is essentially a guideline for designing a building for acceptable indoor air quality, and a performance method, which relies on measurements of the completed building to determine indoor air quality. In this paper, we focus on changes in annual energy use, annual energy operating costs, equipment sizing, and first cost of the heating, ventilating, and air-conditioning (HVAC) system that result from simulations of a building designed and operated to follow the guidelines in the prescriptive method. The interested reader is directed to Nero and Grimsrud [1984] for a general discussion of the performance method.

Under the prescriptive method, the Standard is specified in terms of minimum outside air ventilation rates. That is, since energy-efficiency considerations dictate that commercial buildings recirculate as much indoor air as possible, except during economizer operation, a minimum outside air ventilation rate must be maintained to ensure acceptable indoor air quality, in the absence of exceptional sources. The underlying assumption here is that outdoor ambient, "fresh air" conditions are superior to indoor, recirculated conditions. The measure is units of outside air flow per inhabitant, liters per second per person (L/s.person) or cubic feet per minute per person (cfm/person).

The Standard presently in effect recommends two separate *minimum* outside air ventilation rates that depend on whether smokers are present: 2.5 L/s.person (5 cfm/person) without smokers and 7.5 L/s.person (15 cfm/person) with smokers [ASHRAE 1981]. The proposed Standard does not distinguish the presence of smoking and simply recommends a minimum of 10 L/s.person (20 cfm/person) [ASHRAE 1987]. Whether this new rate of outside air intake is sufficient to ensure truly acceptable indoor air quality is a subject of debate (see, for example, Leaderer and Cain [1984] or Sterling and Sterling [1984]); however, for our purposes, it is the highest rate we evaluate.

Mr. Eto is a Staff Scientist in the Energy Analysis Program of the Lawrence Berkeley Laboratory. Ms. Meyer is a visiting researcher from the Ecole Polytechnique Feminine, Paris, France.

In 1982, Ross, Goodman, and Birdsall published results from a similar study also using a building energy simulation program to estimate the impacts of different ventilation rates [Ross, et al. 1982]. The present study is intended to complement this early, important work and extend the analysis in several new directions:

- The list of locations examined is expanded to include Canadian cities, as well as new U.S. locations.
- Actual current utility tariffs for each site are used for the annual operating energy costs.
- Changes in central plant equipment capacities are used to estimate the changes in HVAC system first costs.

Four sections follow this introduction. The next section provides background for the study with an overview of the methodology, including descriptions of the building energy simulation program, the building prototype, and the locations examined. The following section summarizes the findings for the changes in equipment sizing, energy use, energy costs, and HVAC system first costs. The next section discusses these findings briefly, and the final section is a summary.

## BACKGROUND

This section describes the method of analysis and the building energy simulation program, the building prototype, and the cities used in the study.

### Method of Analysis

The method of analysis relies on a series of parametric building energy simulations in which all features of the building are held fixed, except the minimum outside air ventilation rate. The other aspects of the building description, including its structural, architectural, mechanical, and electrical characteristics and its hours of operation and temperature setpoints, remain unchanged, not only as the minimum ventilation rate changes for a given city, but also across cities. This latter step ensures that results can be compared on a consistent basis between cities as well as within them.

Four simulations were performed for each location, each with a different rate of minimum outside air ventilation. The lowest ventilation rate was 2.5 L/s.person (5 cfm/person) in increments of 2.5-L/s.person (5 cfm/person) to 10.0 l/s.person (20 cfm/person). In normal operation, these ventilation rates are frequently exceeded when, for cooling purposes, additional outside air is taken in through an economizer cycle.

Several outputs of the program were saved from each simulation for use in the subsequent analyses. These outputs include annual energy use for heating, cooling, and ventilation/pumps; annual peak electrical demand; total annual cost of electricity and natural gas (including the cost of electricity used for lighting and other end uses, which do not change as minimum outside air ventilation rates increase); and the size of the chillers and boilers in the central plant.

### DOE-2 Building Energy Analysis Program

The DOE-2 building energy analysis program (version DOE-2.1C) was used to study the changes in energy use, energy costs, and equipment sizing that result from increasing minimum outside air ventilation rates. The DOE-2 program was developed for the Department of Energy to provide architects and engineers with a state-of-the-art tool for estimating building energy performance [Curtis 1984]. The DOE-2 program has been extensively validated [Diamond 1986].

Three features make DOE-2 particularly useful for a study of the energy and cost implications of increased ventilation rates in office buildings:

1. Heating and cooling loads are calculated on an hourly basis.
2. The structure and operation of a building can be entirely specified by user inputs.
3. Version 2.1C of the program allows the user to model actual electricity and natural gas rate tariffs, including time-of-day prices for energy and demand charges, demand charges with sophisticated ratchets, and block rates with dynamic tier boundaries (i.e., boundaries that are a function of demand, as in kWh/kW).

## Office Building Prototype

The office building prototype simulated is based on an actual building of recent vintage with modifications to ensure compliance with ASHRAE Standard 90-1975 [ASHRAE 1975]. This prototype was originally developed for the ASHRAE-sponsored evaluation of revisions to Standard 90 [Battelle 1983]. In that evaluation, the building was slightly altered for each climate; for the present analysis, only one building was used (designed originally for the Washington, DC, climate) for each location.\* Operating schedules were taken from the Standard Building Operating Conditions developed for the Building Energy Performance Standards [DOE 1979]. The HVAC system was designed so that only electricity would be used for cooling and only natural gas would be used for heating (of course, electricity is also used for lighting, fans, pumps, etc.). Slight modifications also made to some aspects of the HVAC system, in order to make the building more representative of current design and operation practices. The modifications include a lower cooling setpoint, a higher economizer setpoint, and reverse-action thermostats. Major features of the office building prototype are summarized in Table 1.

## Locations

The simulations were performed using weather data and utility tariffs from 10 U.S. cities and three Canadian cities. The variables considered in selecting the locations included climatic variation, office building population, and utility rate types and levels.

The weather data were from either the Weather Year for Energy Calculation (WYEC) series developed for ASHRAE [Crow 1981] or from the Typical Meteorological Year series developed by NOAA [NCC 1981]. Both series are intended to be representative of typical conditions in a given location. Where both were available for a given location, the WYEC series was chosen. Table 2 identifies the weather tape used for each location and summarizes the annual heating and cooling degree days found on each tape.

To evaluate the energy costs of increased ventilation rates realistically, current electricity and natural gas tariffs were obtained from the appropriate utility in each location. For locations where consumers can choose service under more than one electricity tariff, we opted for the tariff with time-of-day prices. Tables 3a and 3b identify the utilities and rate schedules and describe briefly the type of rate used for each location.

## RESULTS

This section reports on the results from simulations of the impacts of increased minimum outside air ventilation rates. We begin with the changes in central plant equipment capacities and annual energy use for space conditioning end uses resulting from different ventilation rates, and we conclude with the changes in annual energy operating and building HVAC system costs.

Results of the impacts of increased ventilation rates are reported as percentage changes from the values obtained for a base case. Percentage increases, by normalizing the increases to a base case, provide a better perspective than absolute increase because they facilitate comparisons across climates. Hence, we start by presenting the nominal values of the simulation results for the lowest ventilation rate, 2.5 l/s/person (5 cfm/person). Table 4 summarizes the central plant equipment capacities, the annual heating, cooling, and auxiliary HVAC energy, peak demand, and annual energy costs from our initial simulation for each location. Again, to facilitate comparison, the results have been divided by building area.

Figures 1 and 2 illustrate the impact of increased ventilation rates on boiler and chiller capacities, respectively. (Fan sizes do not change, since their sizing is unaffected by outside air ventilation rates.) For both boilers and chillers, the percentage changes are generally in proportion to the severity of climate. The changes in boiler capacities range from almost no change to about a 10% increase. The largest increases occur in the colder climates and the smallest in milder ones. The maximum change in chiller capacity is somewhat greater, about 20%; the minimum is near 0%. The largest increases in chiller capacity are found in the climates with the greatest cooling requirements, but the trend is less uniform than that for boiler capacities. The most severe cooling climate (Miami), for example, does not have the largest percentage increases. Note that boiler and chiller sizing is a function of the coincident

\* We have determined that use of a single building for all locations, rather than a separate, slightly altered prototype for each location (as was done for the ASHRAE-sponsored research), does not materially affect the findings.

loads of all zones within a building. Consequently, changes in minimum ventilation rates may result in monotonic yet nonlinear changes in sizing due to changes in the coincidence of zonal peak loads.

Figures 3, 4, and 5 present the percentage changes in annual heating, cooling, and auxiliary HVAC energy, respectively. Auxiliary HVAC energy includes both fan and pumping energy. The percentage changes in heating energy range from slightly less than 0% to about 8%. The percentage changes in cooling energy range from less than 1% to nearly 14%. The changes for heating and cooling tend to parallel climatic severity. The percentage changes for HVAC auxiliary energy use are significantly smaller than those found for heating and cooling energy use. The maximum increase is less than 2%. This result is not surprising since a significant component of the auxiliary HVAC energy use is fan energy use, which is largely unaffected ( $\ll 1\%$ ).

Figure 6 shows the percentage changes in electrical peak demand. The maximum increase is less than 8%. Since electricity is used for cooling, but not heating, the increases tend to parallel the severity of the cooling climate.

Figure 7 translates the annual energy use changes into dollars. The percentage changes are much less dramatic than those for annual heating or cooling energy use, with a maximum percentage increase of less than 5%. The reason for the reduced impact is that the energy costs for space conditioning account for only a fraction of the total energy costs of operating the building. There are two reasons: First, the dominant component of annual energy cost is the cost of electricity (see Table 5). Second, electricity use for lighting and miscellaneous equipment is a fixed component that is not changed by increased ventilation rates (again, see Table 5). For these reasons, the more severe cooling climates tend to exhibit the greatest percentage increases in energy costs.

To estimate the changes in first cost, we used the changes in boiler and chiller capacity as proxies for the increases in first cost of the HVAC system. That is, we assumed that the increases in HVAC system cost would scale linearly with the increase in boiler and chiller capacity. This assumption is quite crude, and so we have attempted to derive the estimates very conservatively. Specifically, we assumed that HVAC first cost would increase \$9.5/MJ/h (\$10,000/Mbh) for increases in boiler capacity and \$32.3/MJ/h (\$600/ton) for increases in chiller capacity. These estimates are based on information contained in Saylor [1987].

Figure 8 shows our estimates of the changes in the first cost of HVAC systems resulting from the increased ventilation rates. Contrary to previous results, these estimates are expressed as increases in costs per unit of building area rather than as percentage increases in total building first cost. For perspective, however, the total construction costs of the office building prototype were estimated to be approximately \$1100/m<sup>2</sup> (\$100/ft<sup>2</sup>) in 1987 dollars [Battelle 1983]. Thus, relative to this first cost, the percentage increases are less than 0.4%.

## DISCUSSION

The results presented in the previous section indicate that, for the simulations performed, increased minimum outside air ventilation rates will have small effects on building annual energy and construction costs. In particular, the simulations do not support a one-to-one relationship between percentage increases in minimum outside air ventilation and increases in these costs. For example, a fourfold increase in the minimum ventilation rate corresponds to a maximum increase in annual energy costs of only 5%.

The primary reason for these small increases in energy cost is that energy use for heating, cooling, and auxiliary HVAC end uses represent only a fraction of the total energy costs for modern office buildings. Energy use for lighting and miscellaneous equipment constitutes a large, fixed component of energy costs that is unchanged by increased outside air ventilation rates. In this respect, our assumption of relatively low levels of energy intensity for lighting and miscellaneous equipment has been conservative (see Table 1). Higher values for these end-uses would further decrease the impact of increased outside air ventilation rates.

The second reason for this result has to do with the operation of the HVAC system. In all of our simulations, we assume that an economizer is able to introduce outside air in excess of the minimum ventilation rate whenever the outside air temperature is less than a given value (specifically, we have used a setpoint of 21.1°C or 70°F). For large office buildings, normal operation of an economizer dictates that outside air ventilation rates generally exceed the minimum rates called for in the Standard. That is, increased minimum ventilation rates can only increase energy use when the supply air temperature would otherwise be higher (in the heating mode) or lower (in the cooling mode), but for this minimum rate. In large office buildings, this circumstance only occurs at the extremes of the

\* In general, it is not possible to allocate electricity costs to individual end uses due to the nonlinear structure of electricity rate tariffs. (These same nonlinearities also result in nonlinear changes in annual energy costs.)

temperature scale, i.e., only at very low or very high outside air temperatures. Consequently, for the majority of operating hours, the Standard will have no effect on energy use.

This study focused on the greatest impacts due to increased minimum outside air ventilation rates. Specifically, results were calculated as increases from the lowest current recommended ventilation rate of 2.5 L/s.person (5 cfm/person). A less conservative evaluation would take current design practices, roughly 5 L/s.person (10 cfm/person), as the basis for evaluating changes. In this case, our results would suggest even smaller increases in both first and annual energy operating costs.

There are other reasons, not addressed in this study, why minimum outside air ventilation rates may have little effect on building energy costs. A primary one is that, either by design or by the limitations of outside air damper performance, many buildings are incapable of reducing outside air ventilation rates to the levels called for by the Standard. A recent study by Persily and Grot [1985] indicates that the measured performance of large office buildings frequently exceeds the levels called for by either the existing or the proposed Standard. The study did not, however, examine whether the measured minimum ventilation rates were the same as those designed.

A related problem with measuring the costs of increased outside air ventilation rates in real buildings is the signal-to-noise problem, which suggests that other aspects of building operation will mask or otherwise obscure the impact of increased ventilation rates. A notable and uncontrollable influence is weather-induced fluctuations in energy use and costs, which can easily overwhelm the impact of increased minimum ventilation rates.

Similarly, we have made generous assumptions regarding the increased first cost of compliance. It is possible that the combination of the building industry's traditional practice of oversizing designs for safety and the availability of HVAC equipment in a limited number of finite sizes (which often results in even greater oversizing) may mean no increase in first cost. Thus, there is also a question as to whether the first cost of compliance will result in measurable increases in first cost.

All simulation-based analyses must, of course, be evaluated according to how well their results match reality. A simulation-based analysis requires a detailed description of a single building and a specific mode of operation. To make our results as representative as possible, we have chosen a prototypical large office building and simulated its performance in many locations with a well-documented and extensively validated simulation program. Nevertheless, recent work demonstrates that real buildings rarely perform as simulated, which, often, is to say that real buildings are rarely operated by the assumptions used in the simulation [Piette 1986].

On the other hand, simulations provide a controlled environment in which changes in ventilation rates can be studied in a consistent manner that cannot be duplicated easily in the real world. Hence, in recognition of these limitations and advantages of simulations, our analyses have focused on relative changes rather than on absolute values, which depend on specific building conditions. We maintain that relative changes from simulations yield important insights into the magnitude of the impacts of ventilation standards on the building industry.

## SUMMARY

We have performed a simulation-based analysis of the increases in energy use, energy costs, central plant equipment capacities, and HVAC first costs that result from compliance with different minimum outside air ventilation rate design standards. The analysis relied on parametrically increasing minimum outside air ventilation rates for a prototypical large office building in 10 U.S. and three Canadian locations. The low end of the current standard, 2.5 L/s.person (5 cfm/person), was the basis for comparison of ventilation rates up to the proposed level of 10 L/s.person (20 cfm/person). Economics were evaluated with actual and current utility rate tariffs and with generous HVAC equipment cost assumptions.

The results indicate, for the prototype and climates examined, that with increased ventilation rates:

- Central plant capacities may increase up to 20% for chillers and up to around 10% for boilers in the most severe heating and cooling climates.
- Annual energy use for heating may increase up to 8%. Annual energy use for cooling may increase up to 14%. Annual auxiliary HVAC energy use is largely unaffected with a maximum increase of less than 2%.
- Annual energy operating costs will increase by less than 5%.
- HVAC first costs may increase by, at most,  $\$3.6/\text{m}^2$  ( $\$0.35/\text{ft}^2$ ).

## ACKNOWLEDGMENT


The work described in this paper was funded by the Assistant Secretary for Conservation and Renewable Energy, Office of Building and Community Systems of the U.S. Department of Energy under Contract No. DE-AC03-76SF00098. The authors would also like to thank D. Grimsrud and B. Birdsall of the Lawrence Berkeley Laboratory for their generous advice and tireless encouragement.

## REFERENCES

- "ASHRAE standard 62-81: Ventilation for acceptable indoor air quality." Atlanta: American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc.
- ASHRAE. 1975. "ASHRAE standard 90-75: Energy conservation for buildings/" Atlanta: American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc.
- ASHRAE. 1987. "Proposed revisions to ASHRAE Standard 62-81: Ventilation for acceptable indoor air quality, public review draft." Atlanta: American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc.
- Battelle. 1983. "Recommendations for energy conservation standards and guidelines for new commercial buildings, Volume III, Appendix A: Testing assumptions and inputs." Battelle Pacific Northwest Laboratories, U. S. Department of Energy, DOE/NBB-0051/7, October.
- Crow, L. 1981. "Development of hourly data for weather year for energy calculations (WYEC), including solar data, at 21 stations throughout the U.S." *ASHRAE Transactions*.
- Curtis, R., Birdsall, B., Buhl, W., Erdem, E., Eto, J., Hirsch, J., Olson, K. and Winkelmann, F. 1984. "DOE-2 building energy use analysis program." Lawrence Berkeley Laboratory, LBL-18046,
- Diamond, S., Cappiello, C. and Hunn, B. 1986. "DOE-2 verification project, final report." Los Alamos National Laboratory, 10649-MS.
- Leaderer, B., and Cain, W. 1983. "Air quality in buildings during smoking and nonsmoking occupancy." *ASHRAE Transactions*, V. 89, Pt. 2a and 2b.
- McNall, P. 1984. "The impact of building codes and regulations on indoor air quality." *Proceedings of An Engineering Foundation Conference on Management of Atmospheres in Tightly Enclosed Spaces*.
- National Climatic Center 1981. "Typical meteorological year, user's manual," National Climatic Center.
- Nero, A., and Grimsrud, D. 1984. "Air quality issues in ventilation standards," *5th AIC Conference*, Reno, NV.
- Persily, A., and Grot, R. 1985. "Ventilation measurements in large office buildings." *ASHRAE Transactions*, V. 91, Pt. 2.
- Piette, M., and Riley, R., 1986. "Energy use and peak power for new commercial buildings from the BECA-CN data compilation: key findings and issues." *Proceeding of the 13th Energy Technology Conference, Washington, DC*.
- Ross, H., Goodman, W., and Birdsall, B. 1982. "Impact of ventilation rates on the design of office buildings." *ASHRAE Transactions*, V. 88, Pt. 1.
- Saylor, L. "Current construction costs, 1987," Lee Saylor, Inc.

Sterling, E., and Sterling, T. 1984. "Effects of different ventilation parameters on indoor pollutants." *Proceedings of An Engineering Foundation Conference on Management of Atmospheres in Tightly Enclosed Spaces.*

U. S. Department of Energy 1979. "Standard building operating conditions." DOE/CS-0118.

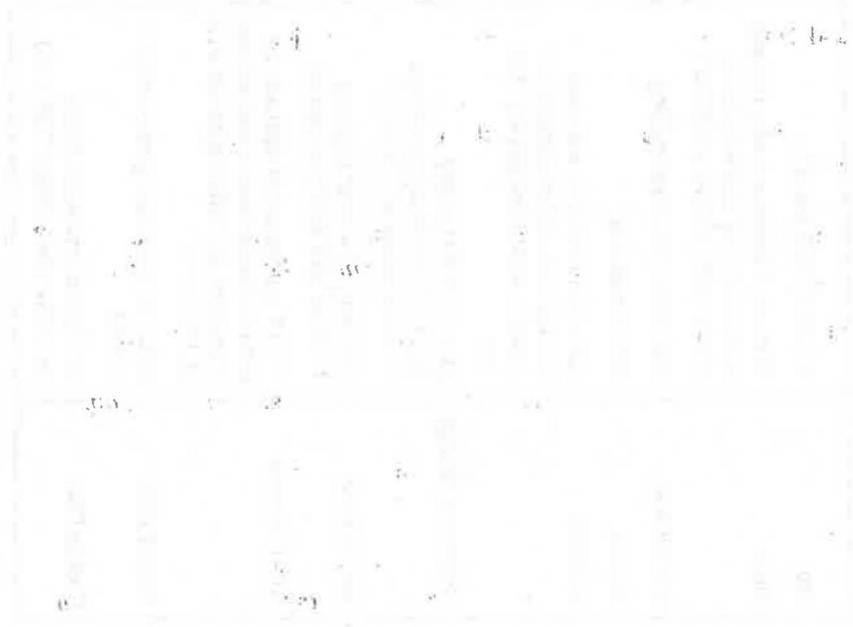

**TABLE 1**

**Summary of Office Building Characteristics**

|                            |   |
|----------------------------|---|
| <b>Size</b>                | 55,530 m <sup>2</sup> (597,500 ft <sup>2</sup> )  |
| <b>Shape</b>               | 38 floors, 2 basement levels, flattened hexagon in cross section, approximately 1,670 m <sup>2</sup> /floor (18,000 ft <sup>2</sup> ) |
| <b>Construction</b>        | Steel frame, limestone cladding   |
| <b>Glazing</b>             | 25% of wall area  |
| <b>Operation</b>           | 8am - 6pm weekdays, with some evening work, 30% occupancy on Saturday, closed Sundays and Holidays                                    |
| <b>Thermostat Settings</b> | 24.4°C (76°F) Cooling<br>22.2°C (72°F) Heating (night and weekend setback 12.8°C (55°F))  |
| <b>Internal Loads</b>      | 25.8 W/m <sup>2</sup> (2.4 W/ft <sup>2</sup> ) lighting<br>7.7 W/m <sup>2</sup> (0.8 W/ft <sup>2</sup> ) equipment                    |
| <b>HVAC Air-side</b>       | 2 VAV systems zoned separately for perimeter (w/terminal reheat) and core (no reheat), dry bulb economizer set at 21.1°C (70°F)       |
| <b>Heating Plant</b>       | 2 Gas-fired hot water generators (eff. = 75%)   |
| <b>Cooling Plant</b>       | 2 Hermetic centrifugal chillers w/cooling tower (chiller COP = 4.3)   |

**TABLE 2**

**Summary of Climatic Conditions**

| City          | Weather Type      | Annual Heating Degree-Days <sup>1</sup> |           | Annual Cooling Degree-Days <sup>1</sup> |          |
|---------------|-------------------|---|-----------|---|----------|
|               |                   | °C                                      | (°F)      | °C                                      | (°F)     |
| Atlanta       | WYEC <sup>2</sup> | 1675.8                                  | (3016.5)  | 877.2                                   | (1579.0) |
| Boston        | WYEC              | 3163.6                                  | (5694.5)  | 401.7                                   | (723.0)  |
| Chicago       | WYEC              | 3424.4                                  | (6164.0)  | 543.9                                   | (979.0)  |
| Dallas        | WYEC              | 1320.3                                  | (2376.5)  | 1412.8                                  | (2543.0) |
| Miami         | WYEC              | 126.1                                   | (227.0)   | 2225.0                                  | (4005.0) |
| Minneapolis   | WYEC              | 4483.6                                  | (8070.5)  | 416.9                                   | (750.5)  |
| New York      | WYEC              | 2745.0                                  | (4941.0)  | 574.4                                   | (1034.0) |
| San Francisco | TMY <sup>3</sup>  | 1808.9                                  | (3256.0)  | 39.7                                    | (71.5)   |
| San Diego     | TMY               | 714.2                                   | (1285.5)  | 365.0                                   | (657.0)  |
| Washington    | WYEC              | 2353.3                                  | (4236.0)  | 791.7                                   | (1425.0) |
| Montreal      | WYEC              | 4580.0                                  | (8244.0)  | 192.2                                   | (346.0)  |
| Vancouver     | WYEC              | 3185.3                                  | (5733.5)  | 18.3                                    | (33.0)   |
| Winnipeg      | WYEC              | 6041.1                                  | (10874.0) | 136.1                                   | (245.0)  |

Note 1: calculated to base 18.3°C (65°F)

Note 2: Weather Year for Energy Calculation

Note 3: Typical Meteorological Year

TABLE 3a

U.S. Utility Rate Schedules

| City/Utility*                  | Schedule | Type                               |
|--------------------------------|----------|------------------------------------|
| <b>Atlanta</b>                 |          |                                    |
| Georgia Power Co.              | PL-6     | Declining block<br>w/demand charge |
| Atlanta Gas Co.                | N-2      | Declining block                    |
| <b>Boston</b>                  |          |                                    |
| Boston Edison Co.              | T-2      | Time of use                        |
| Boston Gas Co.                 | No. 3    | Declining block                    |
| <b>Chicago</b>                 |          |                                    |
| Commonwealth Edison Co.        | 6L       | Time of use                        |
| Peoples Gas                    | No. 2    | Flat rate                          |
| <b>Dallas</b>                  |          |                                    |
| Texas Utilities Electric Co.   | G        | Declining block<br>w/demand charge |
| Lone Star Gas Co.              | No. 951  | Declining block                    |
| <b>Miami</b>                   |          |                                    |
| Florida Power and Light Co.    | GSLDT-2  | Time of use                        |
| Peoples Gas System             | GSLV     | Flat rate                          |
| <b>Minneapolis</b>             |          |                                    |
| Northern States Power Co.      | Gen. TOD | Time of use                        |
| Northern States Power Co.      | C&I Svc. | Time of use                        |
| <b>New York</b>                |          |                                    |
| Consolidated Edison Co.        | No. 9    | Time of use                        |
| Consolidated Edison Co.        | No. 2    | Declining block                    |
| <b>San Diego</b>               |          |                                    |
| San Diego Gas and Electric Co. | AO-TOU   | Time of use                        |
| San Diego Gas and Electric Co. | GN-1     | Flat rate                          |
| <b>San Francisco</b>           |          |                                    |
| Pacific Gas and Electric Co.   | E-20     | Time of use                        |
| Pacific Gas and Electric Co.   | G-50     | Declining block<br>w/demand charge |
| <b>Washington</b>              |          |                                    |
| Potomac Electric Power Co.     | DC-GT    | Time of use                        |
| Washington Gas Light Co.       | Sch. 2   | Flat rate                          |

\* For each city, the electric utility is listed first, followed by the gas utility.

TABLE 3b

Canadian Utility Rate Schedules

| City/Utility*            | Schedule  | Type                               |
|--------------------------|-----------|------------------------------------|
| <b>Montreal</b>          |           |                                    |
| Hydro-Quebec             | Rate M    | Declining block                    |
| Gaz Metroplitain         | Rate 1    | Declining block                    |
| <b>Vancouver</b>         |           |                                    |
| BC Hydro and Power Auth. | GS        | Declining block<br>w/demand charge |
| BC Hydro and Power Auth. | GS        | Declining block                    |
| <b>Winnipeg</b>          |           |                                    |
| Winnipeg Hydro           | Pwr. Std. | Declining block<br>w/demand charge |
| ICG Utilities            | Other     | Declining block                    |

\* For each city, the electric utility is listed first, followed by the gas utility.

TABLE 4

Summary of Baseline Simulations at 2.5 l/s.person (5 cfm/person)


| Location      | Boiler Capacity      |                           | Chiller Capacity     |                              | Heating Energy    |                         | Cooling Energy     |                        | HVAC Aux. Energy   |                        | Peak Demand      |                      | Energy Cost                |                                |
|---------------|----------------------|---------------------------|----------------------|------------------------------|-------------------|-------------------------|--------------------|------------------------|--------------------|------------------------|------------------|----------------------|----------------------------|--------------------------------|
|               | kJ/hr.m <sup>2</sup> | (Btu/hr.ft <sup>2</sup> ) | kJ/hr.m <sup>2</sup> | (Tons/1000 ft <sup>2</sup> ) | MJ/m <sup>2</sup> | (kBtu/ft <sup>2</sup> ) | kWh/m <sup>2</sup> | (kWh/ft <sup>2</sup> ) | kWh/m <sup>2</sup> | (kWh/ft <sup>2</sup> ) | W/m <sup>2</sup> | (W/ft <sup>2</sup> ) | 1987 U.S.\$/m <sup>2</sup> | (1987 U.S.\$/ft <sup>2</sup> ) |
| Atlanta       | 459.7                | (40.5)                    | 369.2                | (2.7)                        | 159.6             | (14.1)                  | 35.6               | (3.3)                  | 32.2               | (3.0)                  | 78.1             | (7.3)                | 14.0                       | (1.3)                          |
| Boston        | 610.7                | (53.8)                    | 354.2                | (2.6)                        | 297.1             | (26.2)                  | 20.9               | (1.9)                  | 30.6               | (2.8)                  | 75.0             | (7.0)                | 26.5                       | (2.5)                          |
| Chicago       | 581.8                | (51.3)                    | 377.3                | (2.8)                        | 311.2             | (27.4)                  | 24.1               | (2.2)                  | 33.2               | (3.1)                  | 78.3             | (7.3)                | 19.8                       | (1.8)                          |
| Dallas        | 410.5                | (36.2)                    | 403.2                | (3.0)                        | 153.6             | (13.5)                  | 40.5               | (3.8)                  | 35.2               | (3.3)                  | 80.4             | (7.5)                | 11.8                       | (1.1)                          |
| Miami         | 194.1                | (17.1)                    | 378.7                | (2.8)                        | 31.1              | (2.7)                   | 58.2               | (5.4)                  | 35.8               | (3.3)                  | 79.4             | (7.4)                | 14.7                       | (1.4)                          |
| Minneapolis   | 739.1                | (65.1)                    | 367.8                | (2.7)                        | 370.5             | (32.6)                  | 19.7               | (1.8)                  | 30.9               | (2.9)                  | 74.8             | (6.9)                | 10.5                       | (1.0)                          |
| New York      | 493.1                | (43.4)                    | 344.8                | (2.5)                        | 247.9             | (21.8)                  | 24.0               | (2.2)                  | 29.8               | (2.8)                  | 75.1             | (7.0)                | 25.6                       | (2.4)                          |
| San Francisco | 374.4                | (33.0)                    | 299.7                | (2.2)                        | 152.8             | (13.5)                  | 19.0               | (1.8)                  | 29.3               | (2.7)                  | 67.5             | (6.3)                | 15.8                       | (1.5)                          |
| San Diego     | 232.6                | (20.5)                    | 339.2                | (2.5)                        | 88.3              | (7.8)                   | 33.0               | (3.1)                  | 32.2               | (3.0)                  | 72.4             | (6.7)                | 23.8                       | (2.2)                          |
| Washington    | 457.3                | (40.3)                    | 365.1                | (2.7)                        | 214.1             | (18.9)                  | 29.3               | (2.7)                  | 31.6               | (2.9)                  | 77.7             | (7.2)                | 13.1                       | (1.2)                          |
| Montreal      | 614.5                | (54.1)                    | 405.9                | (3.0)                        | 362.9             | (32.0)                  | 18.9               | (1.8)                  | 30.3               | (2.8)                  | 76.0             | (7.1)                | 8.9                        | (0.8)                          |
| Vancouver     | 476.4                | (42.0)                    | 301.0                | (2.2)                        | 246.2             | (21.7)                  | 12.9               | (1.2)                  | 27.4               | (2.5)                  | 67.9             | (6.3)                | 6.7                        | (0.6)                          |
| Winnipeg      | 761.4                | (67.1)                    | 382.8                | (2.8)                        | 504.6             | (44.5)                  | 15.4               | (1.4)                  | 30.7               | (2.8)                  | 77.8             | (7.2)                | 7.2                        | (0.7)                          |

TABLE 5

Electricity and Utility Cost Breakdown

|               | Cooling and Aux.<br>HVAC Electricity<br>as a fraction of<br>Total Electricity<br>(%) | Electricity Costs<br>as a fraction of<br>Total Energy Costs<br>(%) |
|---------------|--|--|
| Atlanta       | 40.8   | 93.8   |
| Boston        | 34.3   | 94.3   |
| Chicago       | 36.8   | 97.8   |
| Dallas        | 43.4   | 94.5   |
| Miami         | 48.8   | 99.3   |
| Minneapolis   | 33.9   | 87.8   |
| New York      | 35.3   | 94.5   |
| San Francisco | 32.9   | 96.6   |
| San Diego     | 39.8   | 97.7   |
| Washington    | 38.2   | 87.7   |
| Montreal      | 33.3   | 81.9   |
| Vancouver     | 29.1   | 88.7   |
| Winnipeg      | 31.9   | 82.1   |


### Percent Change in Boiler Capacity

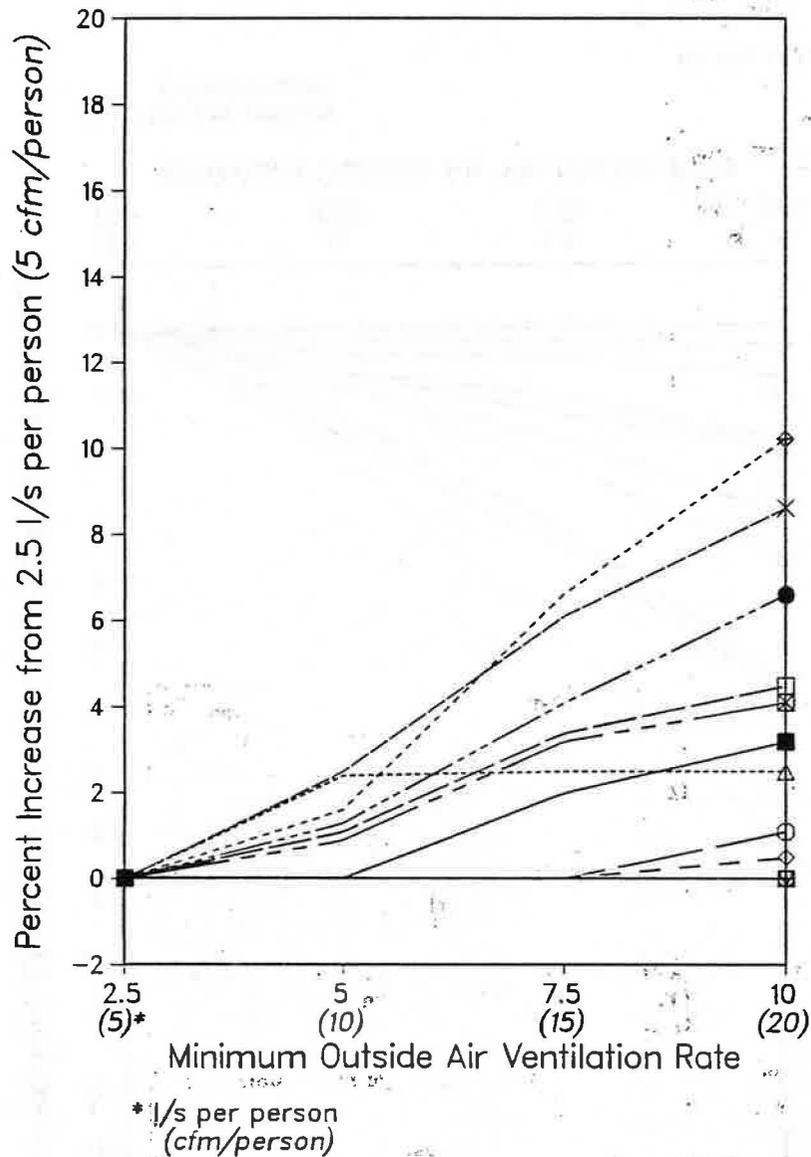

XCG 8711-11448

Figure 1 Percent change in boiler capacity as a function of increases in minimum outside air ventilation rates

### Percent Change in Chiller Capacity

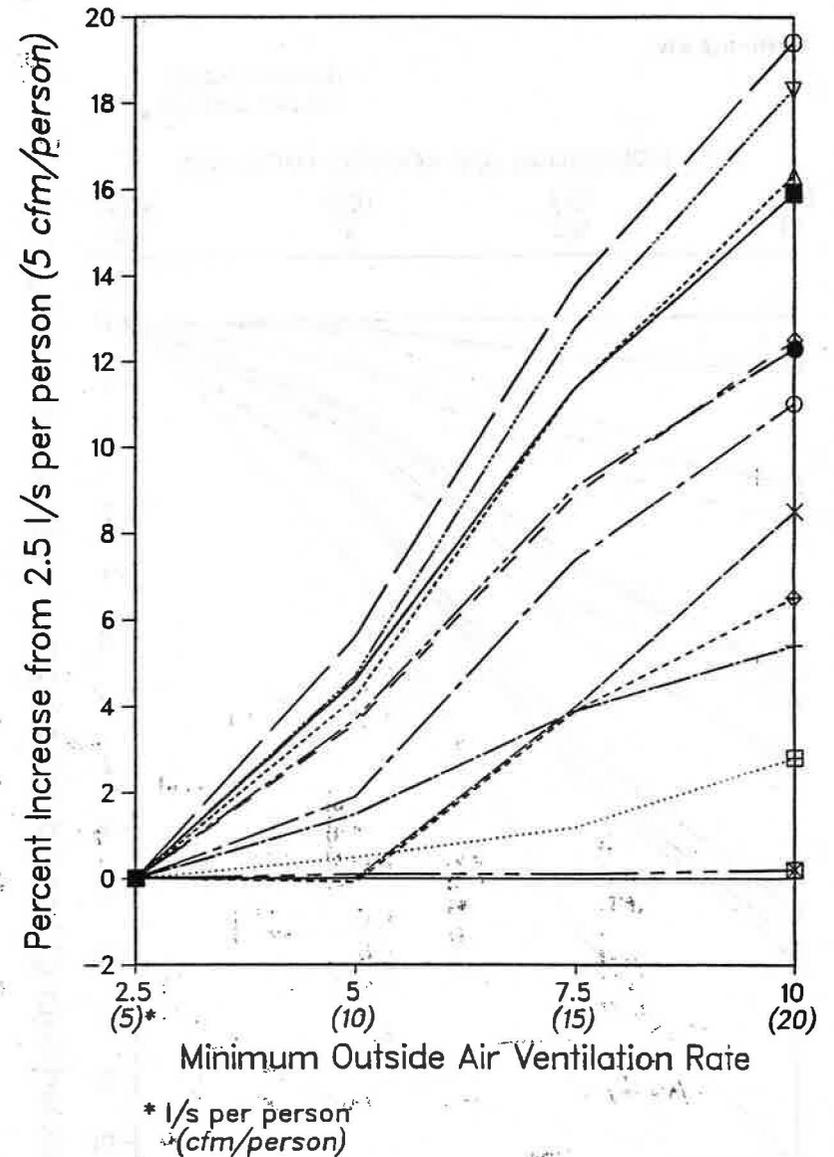

XCG 8711-11449

Figure 2 Percent change in chiller capacity as a function of increases in minimum outside air ventilation rates

12

### Percent Change in Heating Energy

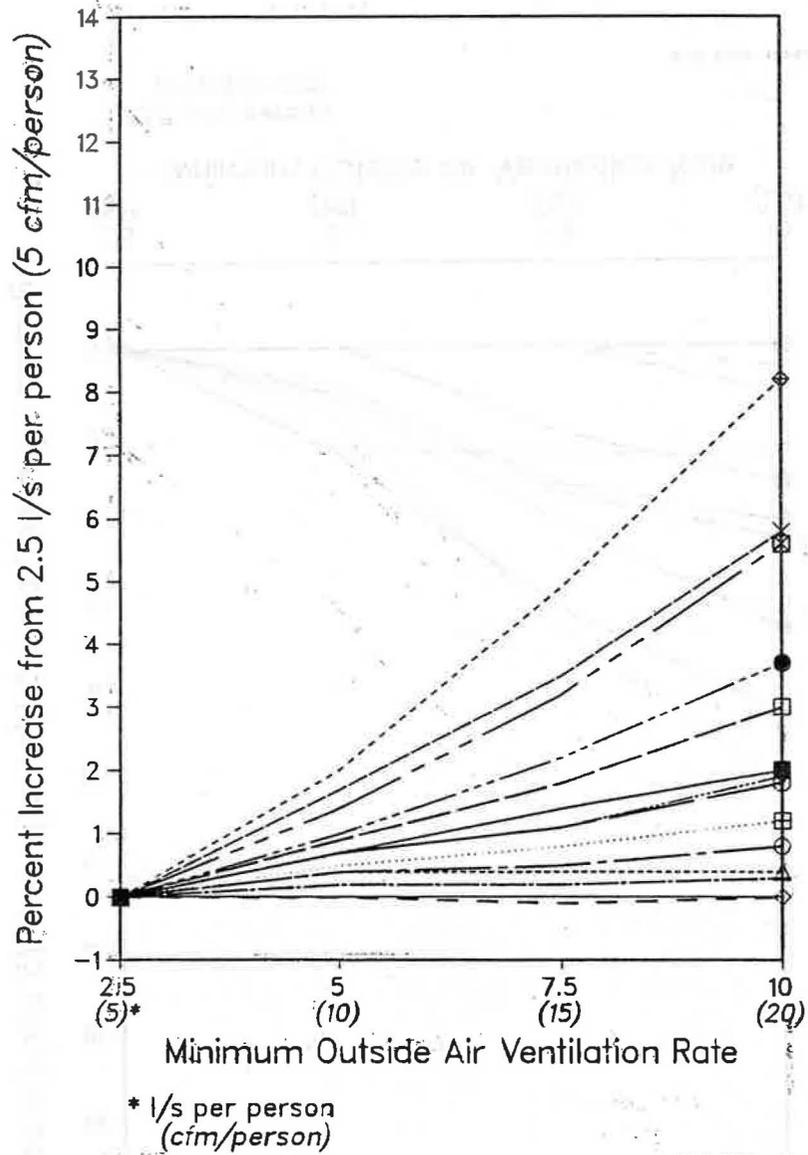


Figure 3 Percent change in heating energy as a function of increases in minimum outside air ventilation rates

### Percent Change in Cooling Energy


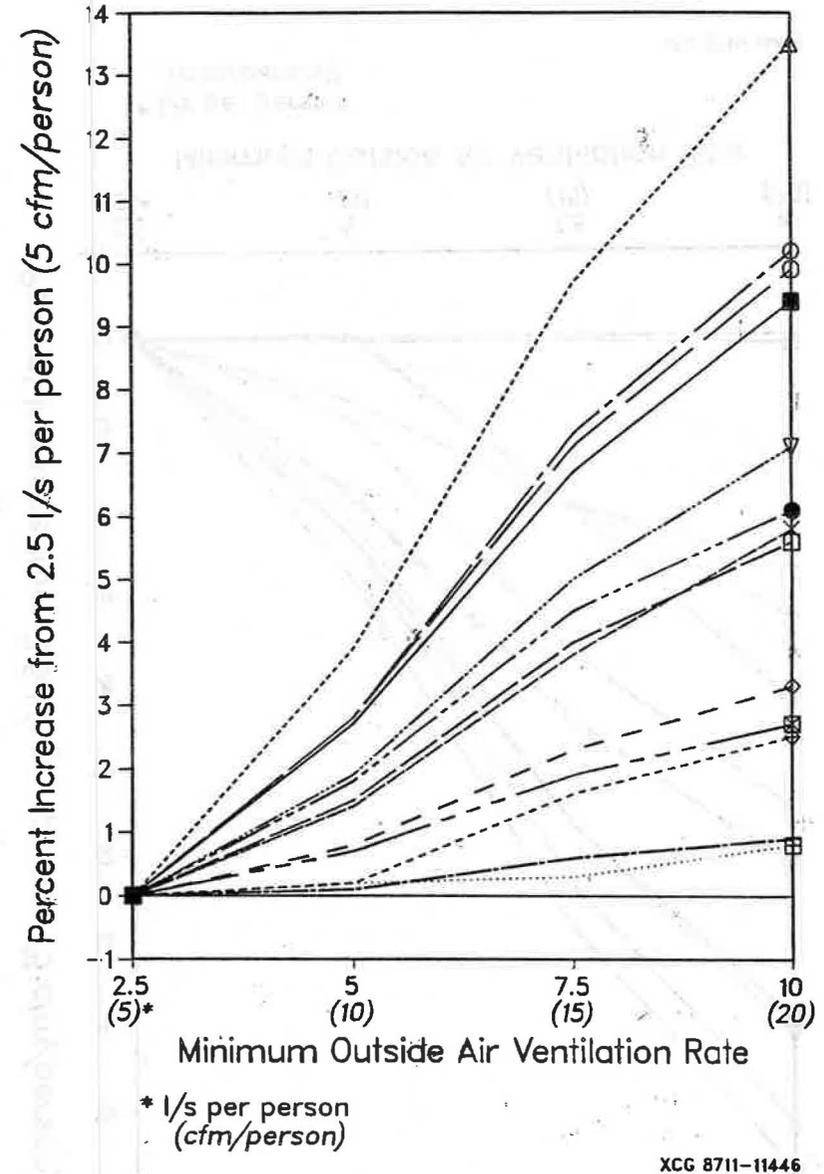


Figure 4 Percent change in cooling energy as a function of increases in minimum outside air ventilation rates

Percent Change in Auxiliary HVAC Energy

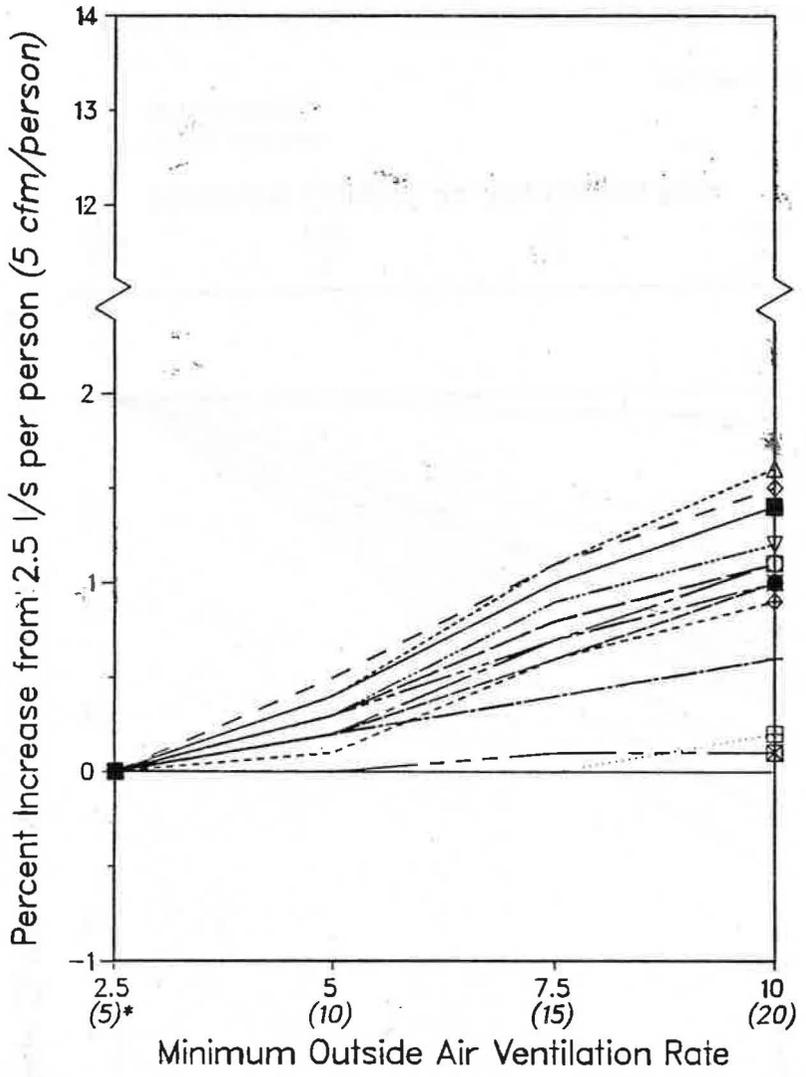


- Legend
- Atlanta
  - Boston
  - Chicago
  - Dallas
  - △ Miami
  - × Minneapolis
  - ▽ New York
  - + San Francisco
  - ◇ San Diego
  - Washington
  - Montreal
  - ⊞ Vancouver
  - ⊕ Winnipeg

XCG 8711-11447

Figure 5 Percent change in auxiliary HVAC energy as a function of increases in minimum outside air ventilation rates

Percent Change in Peak Demand

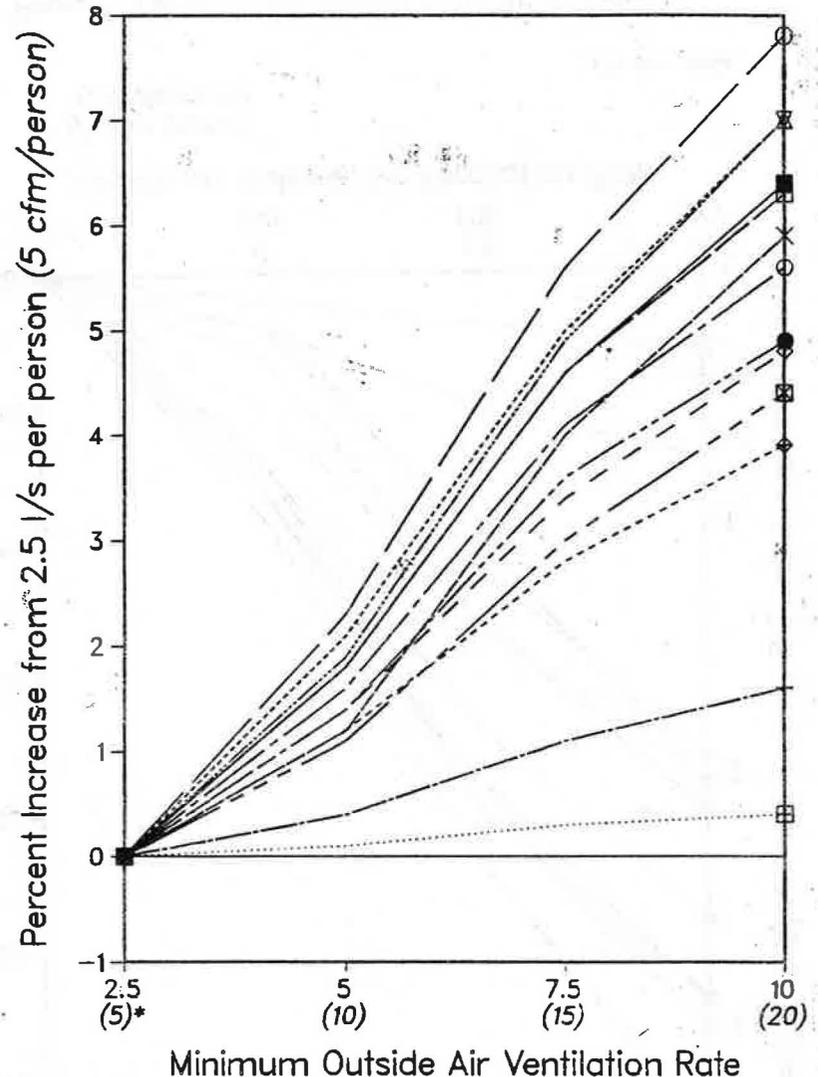

XCG 8711-11443

Figure 6 Percent change in peak electrical demand as a function of increases in minimum outside air ventilation rates

51

### Percent Change in Annual Energy Costs

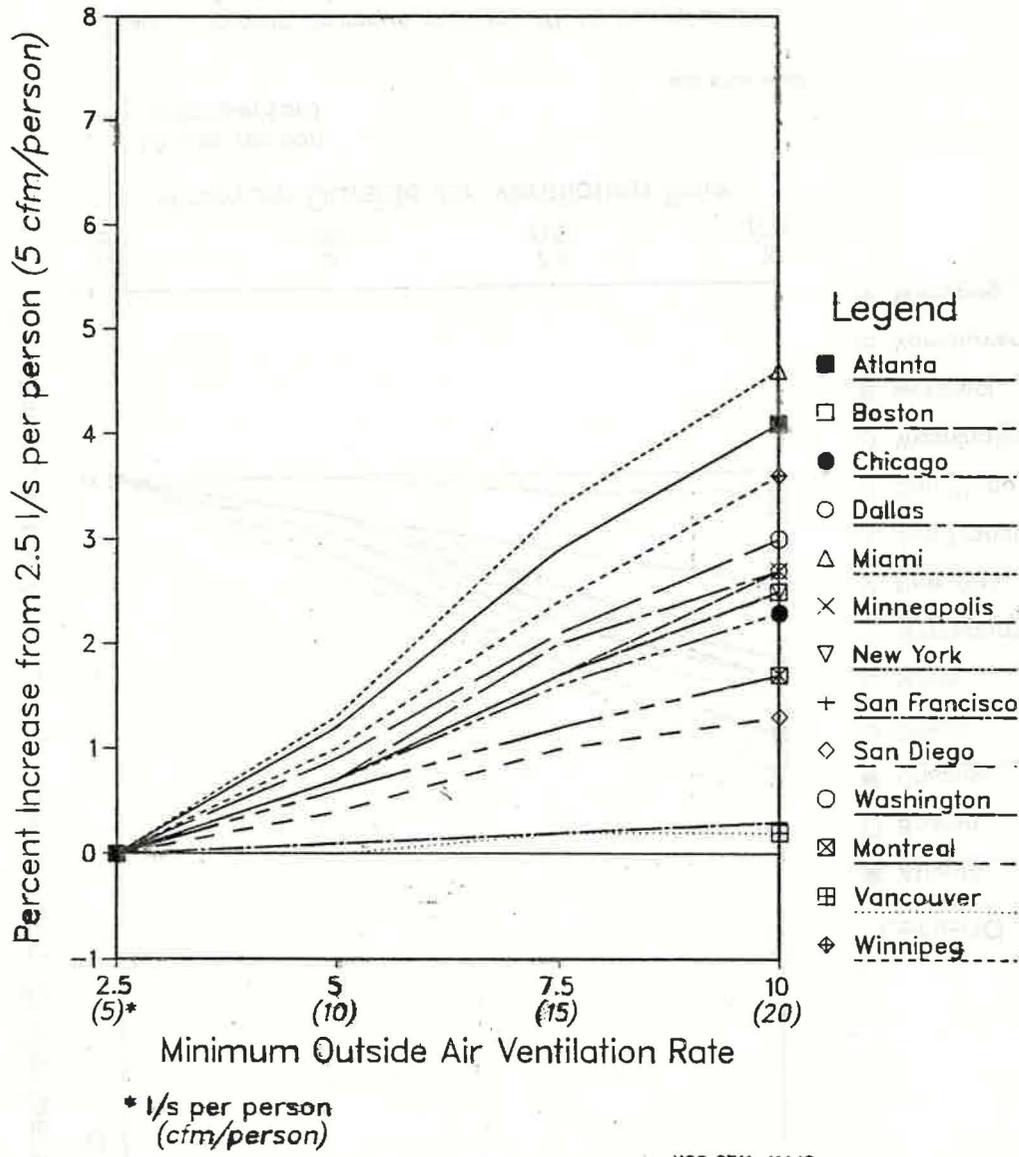


Figure 7 Percent change in total annual energy costs as a function of increases in minimum outside air ventilation rates

XCG 8711-11442

### Increases in HVAC First Cost

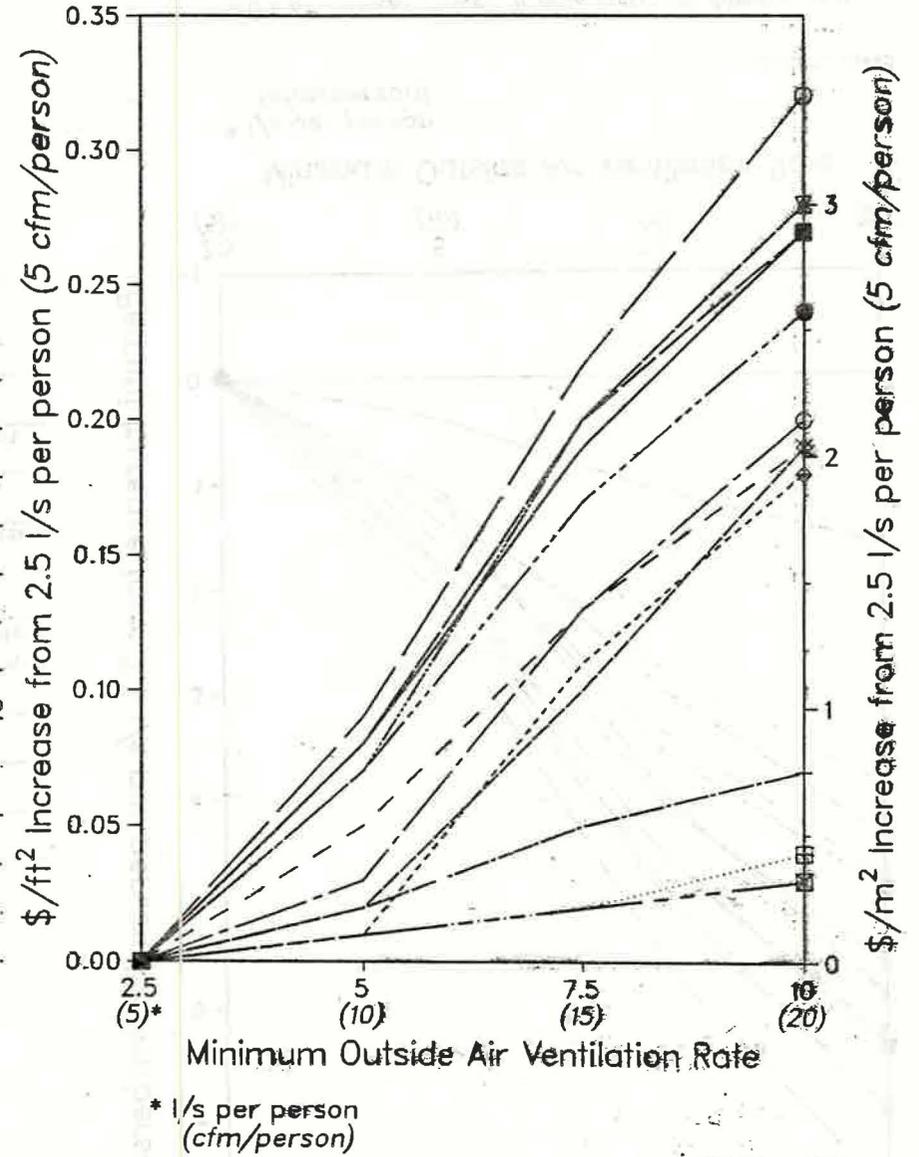


Figure 8 Changes in the first cost of the HVAC system as a function of increases in minimum outside air ventilation rates

XCG 8711-11444